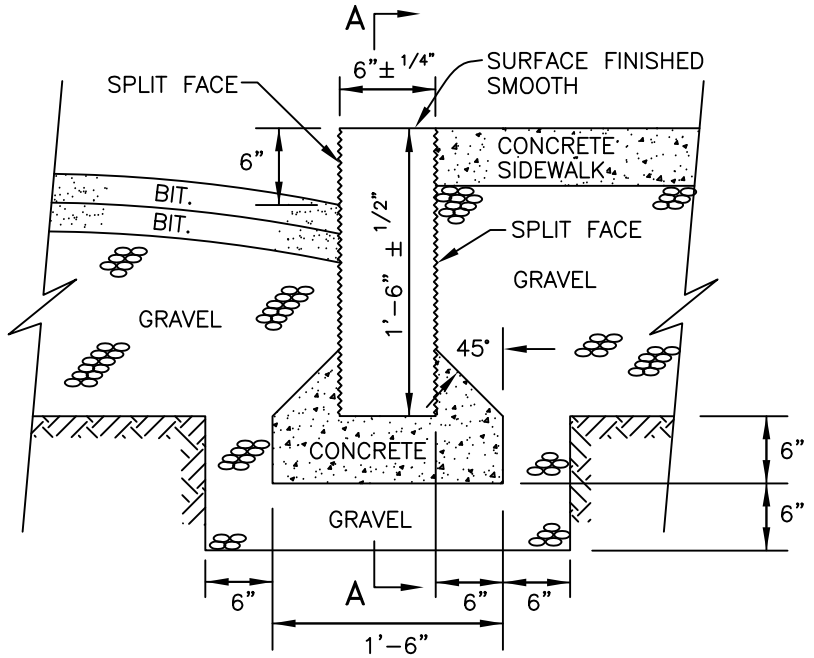

GRANITE STONE CURB

SCALE: 3/4" = 1'-0"

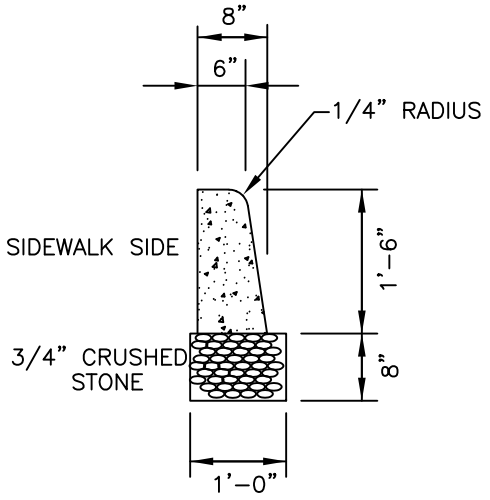

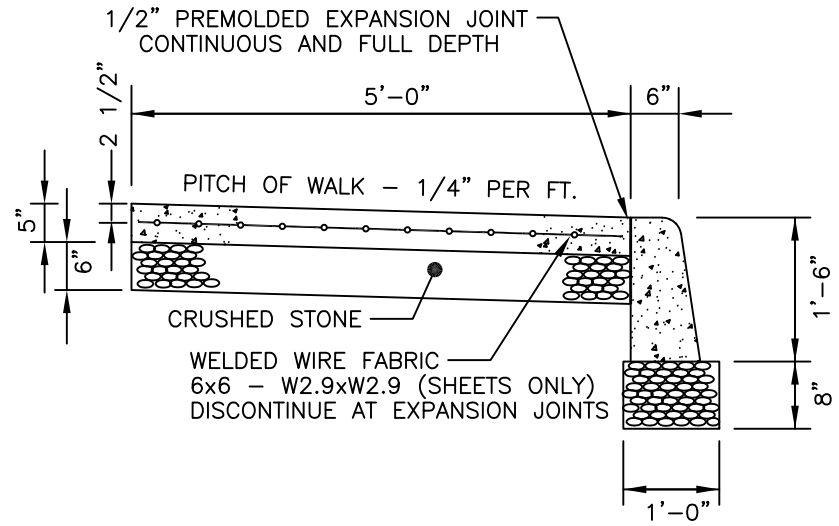

NOTE: A 1/8" STEEL DIVISION PLATE SHALL BE PLACED AT EVERY 10 FEET OF CURBING & REMOVED AFTER CONCRETE HAS SET, A 1/2" APPROVED BITUMINOUS JOINT SHALL BE PLACED AT A MAX. OF EVERY 20 FEET COINCIDING WITH EXPANSION JOINT IN SIDEWALK

CONTRACTOR TO CONSTRUCT 2" BATTER ON CONCRETE CURBING (STREET SIDE ONLY)

STANDARD CURB & SIDEWALK

SCALE: 1/2" = 1'-0"

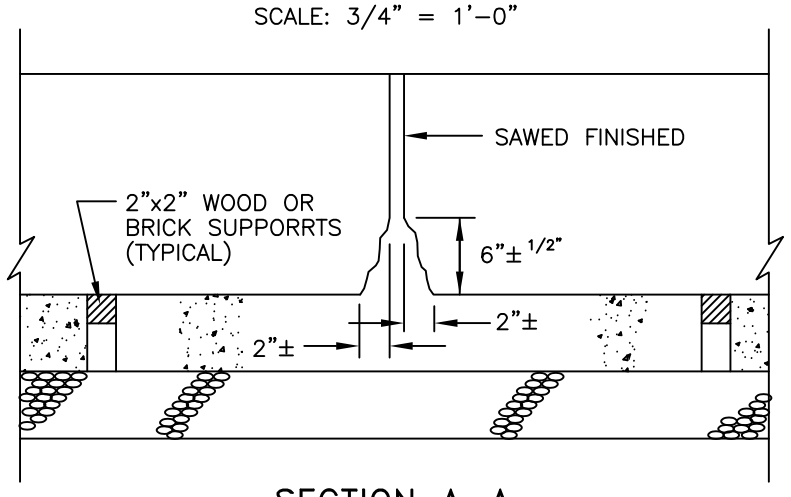

SECTION A-A

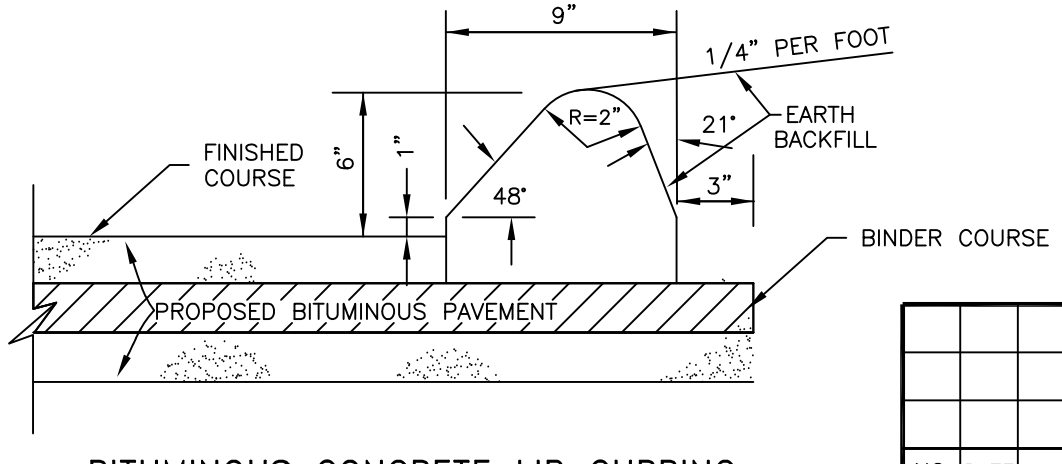

BITUMINOUS CONCRETE LIP CURBING

MACHINED FORMED

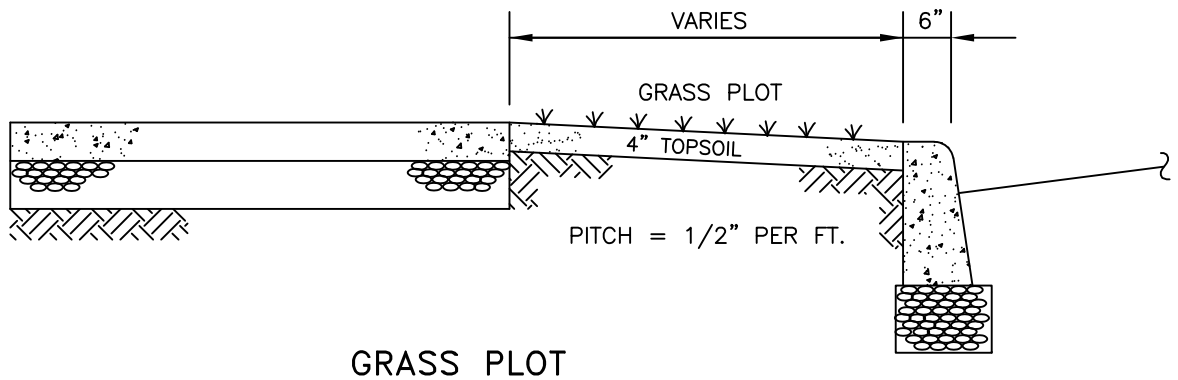

GRASS PLOT

NOTES:

1. ALL REINFORCING SHALL BE SUPPORTED ON CHAIRS OR OTHER POSITIVE TYPE SUPPORTS APPROXIMATELY ONE PER 25 SQ.FT.
2. CONCRETE SHALL BE CLASS "C" CEMENT TYPE II, 3000 PSI
3. AIR ENTRAINMENT SHALL BE BETWEEN 6 - 7%.

NO.	DATE	DESCIPTION	CK.

REVISIONS

TOWN OF WILTON

Department of Public Works

SKETCHES & CALCULATIONS

Project No. & Name STANDARDS

Subject SIDEWALKS & CURBING

Made by F. Smeriglio Date 2/20/19

Chk. by F. Smeriglio Date 2/20/19

SW-1 Sheet No. 1 of 2