


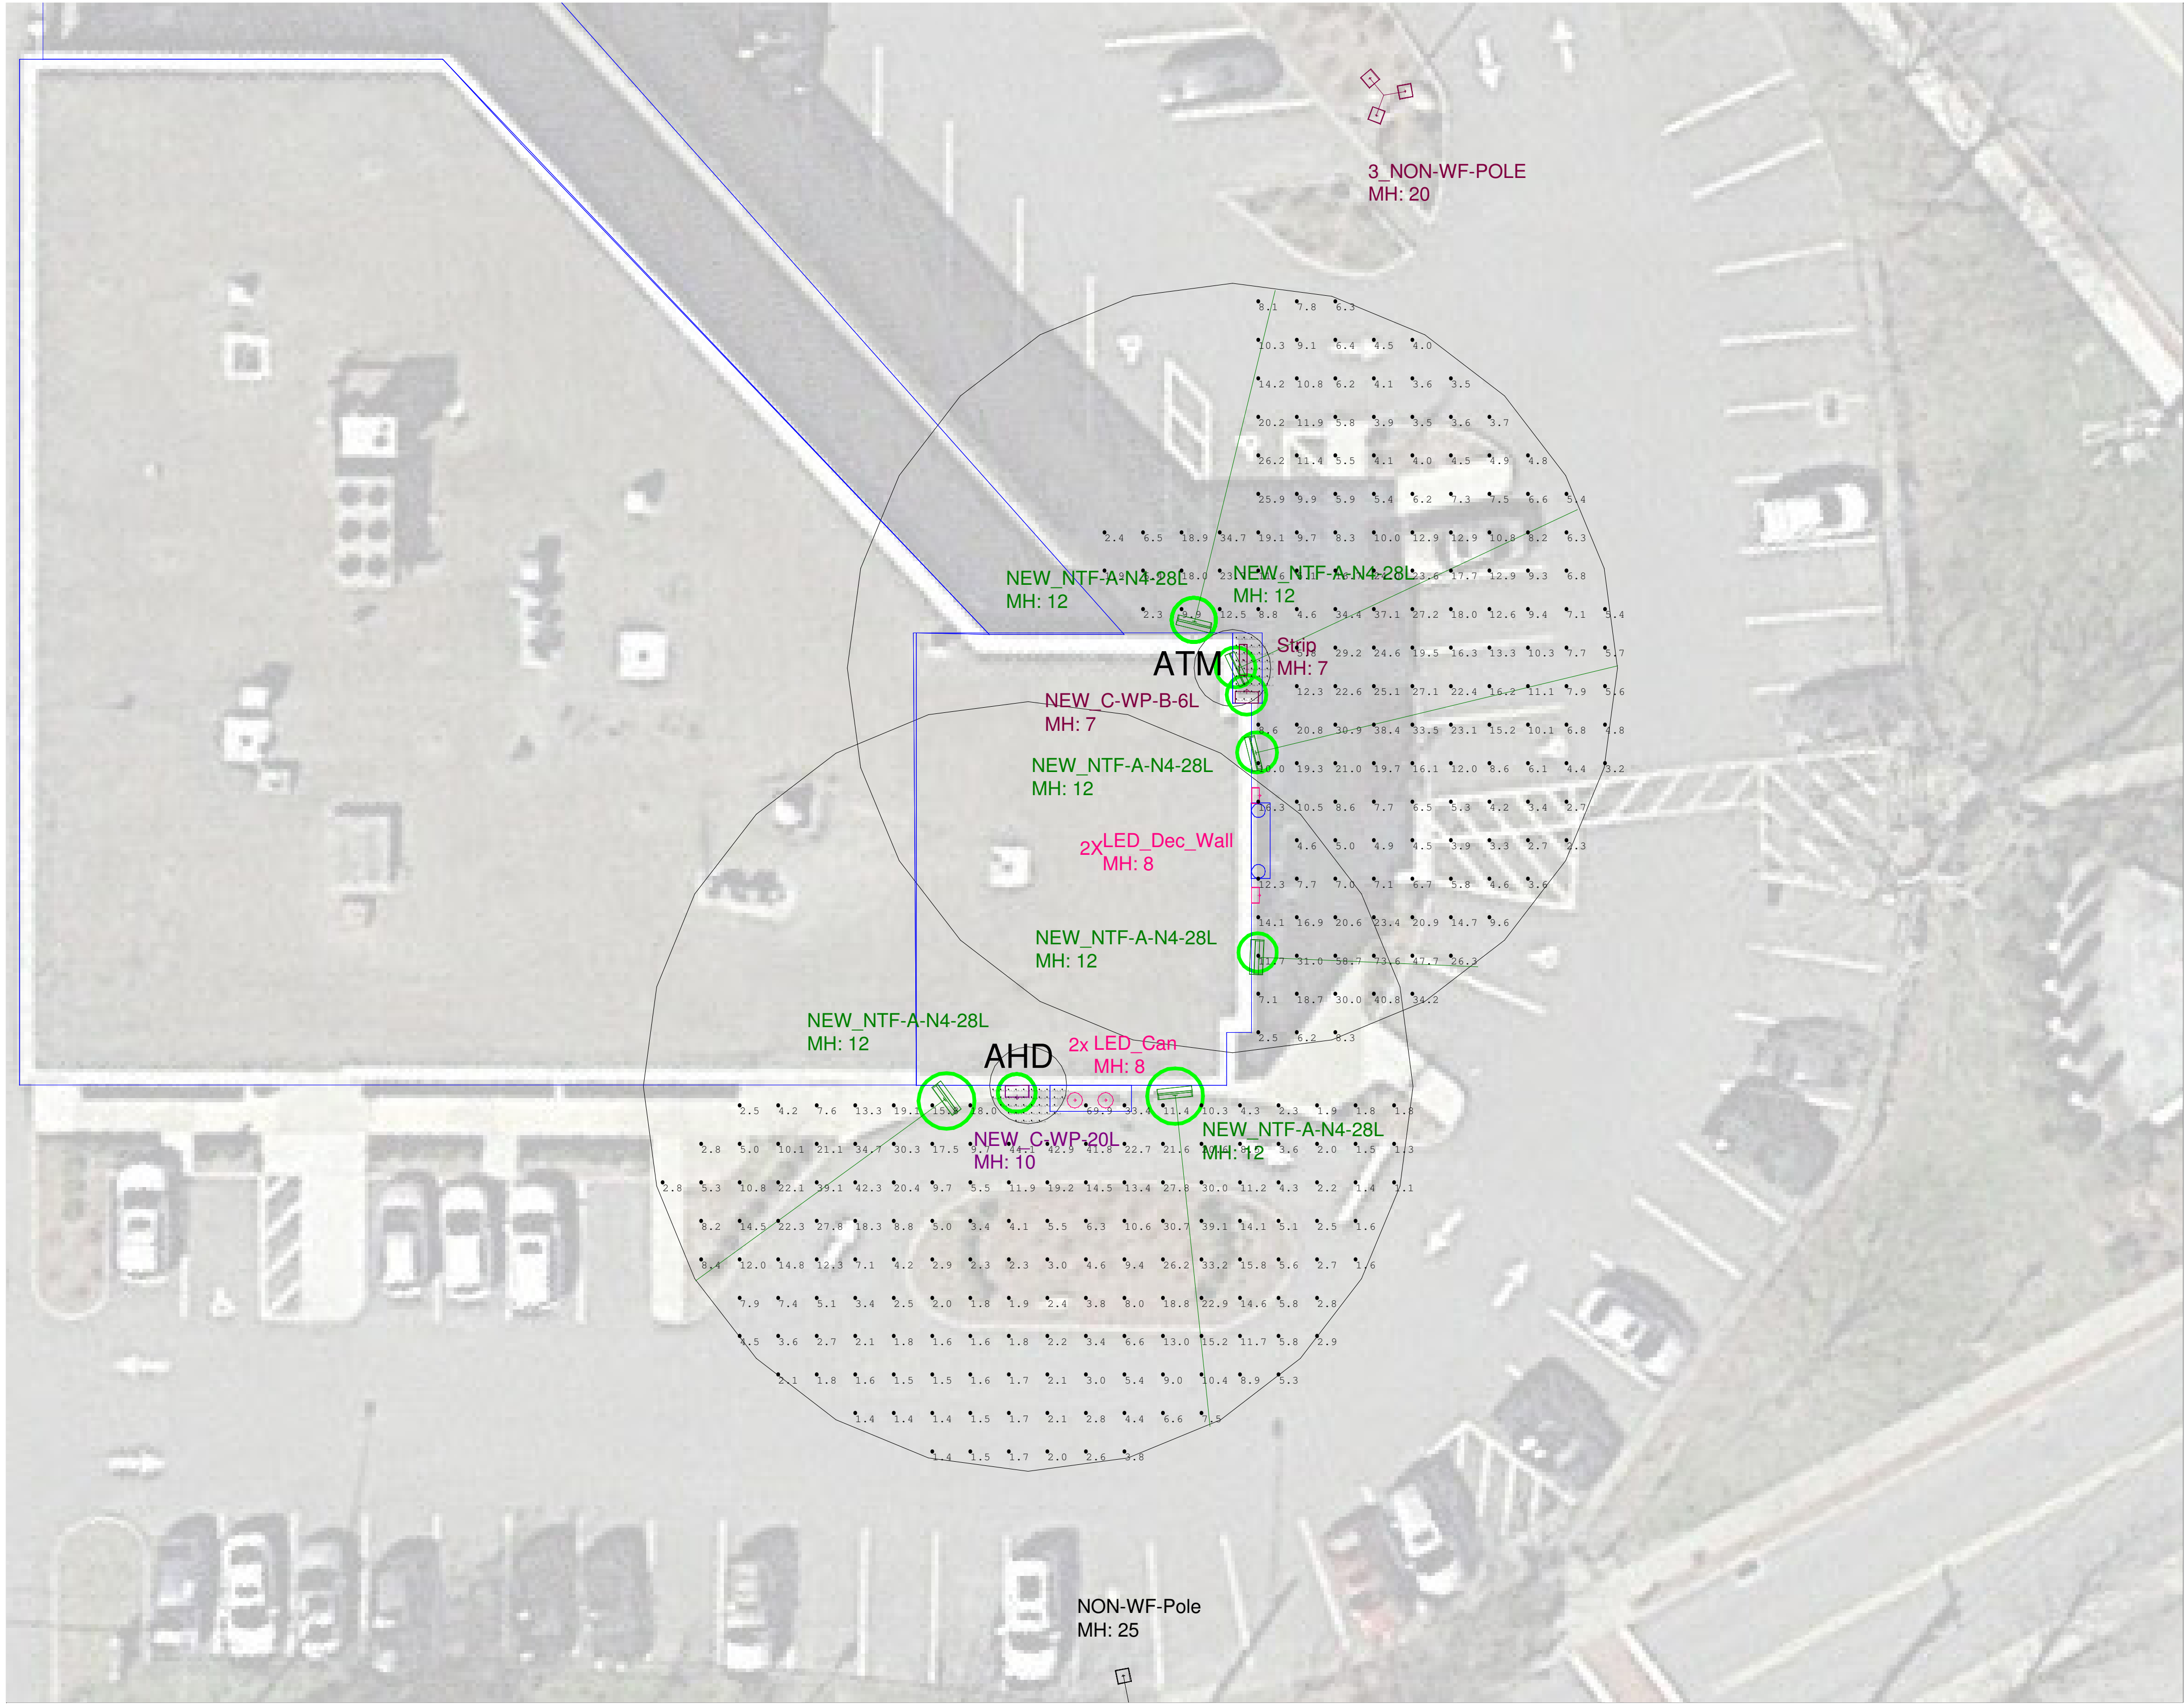

| Luminaire Schedule                                                                |     |                  |                                             |            |                  |       |
|-----------------------------------------------------------------------------------|-----|------------------|---------------------------------------------|------------|------------------|-------|
| Symbol                                                                            | Qty | Label            | Description                                 | Arr. Watts | Arr. Lum. Lumens | LLF   |
|  | 1   | NEW_C-WP-20L     | C-WP-B-RDC-20L-40K-DB                       | 143.5      | 20860            | 0.880 |
|  | 6   | NEW_NTF-A-N4-28L | NTF-A-NM-N4-28L-40K-ULBZ With NTF-TV-28L-BZ | 186        | 28600            | 0.880 |
|  | 2   | LED_Dec_Wall     | For Reference only                          | 13         | 1050             | 0.880 |
|  | 2   | LED_Can          | For Reference only                          | 13         | 1050             | 0.880 |
|  | 1   | Strip            | Relamped with (2) LED11BDT8/G4/840          | 23         | 2000             | 0.880 |
|  | 1   | NEW_C-WP-B-6L    | C-WP-B-RDC-6L-40K-DB                        | 46.4       | 6214             | 0.880 |
|  | 1   | 3_NON-WF-POLE    | For Reference only                          | 216.18     | 33405            | 0.880 |
|  | 1   | NON-WF-Pole      | For reference only                          | 114.07     | 17657            | 1.000 |

Site Notes:  
-6 New floods and 2 New wallpacks are proposed to achieve the compliance and marked with green circles.  
-Strip is relamped with T8 lamp solution as indicated in the LED output table.  
-LED fixtures are captured for reference only.  
-All fixtures are placed as per the audit data.

Note:"No surface mounted conduit will be allowed on the building".

Landlord Approval is required

| MOUNTING HARDWARE ACCESSORIES |                                     |               | Finish            |                  |                   |       |                  |
|-------------------------------|-------------------------------------|---------------|-------------------|------------------|-------------------|-------|------------------|
| QTY                           | Description                         | CAT Logic     |                   |                  |                   |       |                  |
| -                             | OSQ-Direct Arm Mount                | OSQ-DA        | SVHVL<br>(Silver) | BKHVL<br>(Black) | BZHVL<br>(Bronze) | GRHVL | WHHVL<br>(White) |
| -                             | OSQ-Adjustable Arm Mount            | OSQ-AA        |                   |                  |                   |       |                  |
| -                             | Single Side Mount Bracket           | SQ-SP-D       |                   |                  |                   |       |                  |
| -                             | Spring-Mount Ceiling Cover Plate    | CP9000        |                   |                  |                   |       |                  |
| -                             | NTF-Knuckle Mount                   | NTF-KN-BZ     |                   |                  |                   |       |                  |
| -                             | Tenon Square - 4 at 90 deg          | PB-4A4        |                   |                  |                   |       |                  |
| -                             | Single Round Tenon Reducer          | 79918         |                   |                  |                   |       |                  |
| -                             | Tenon Round - 2 at 180 deg.         | 79918 & 79952 |                   |                  |                   |       |                  |
| -                             | Tenon Round - 3 at 180 deg.         | 79918 & 79954 | SV                | BK               | BZ                | GR    | WH               |
| -                             | NTF-Trunnion Mount                  | NTX-TR-BZ     |                   |                  |                   |       |                  |
| -                             | PSG Beauty plate                    | OG15X9        |                   |                  |                   |       |                  |
| 2                             | Wall Mount Bracket                  | WM-SP-D       |                   |                  |                   |       |                  |
| -                             | Vertical Tenon Mount Bracket        | SP-TR-D       | SV                | BK               | BZ                | GR    | WH               |
| -                             | OSQ-HO-Direct Arm Mount             | OSQ-HO-DA-BZ  |                   |                  |                   |       |                  |
| -                             | OSQ-HO-Adjustable Arm Mount         | OSQ-HO-AABZ   |                   |                  |                   |       |                  |
| -                             | Goof Ring-8"                        | GRRCRPTWT     |                   |                  |                   |       |                  |
| -                             | Goof Ring-10"                       | GRRC10RPTWT   |                   |                  |                   |       |                  |
| -                             | Goof Ring-12"                       | GRRC12RPTWT   |                   |                  |                   |       |                  |
| -                             | Goof Ring-6"                        | GRRCRPTWT     |                   |                  |                   |       |                  |
| -                             | 2 X 2 Surface Mount                 | C-ACC-PSMK22  |                   |                  |                   |       |                  |
| 6                             | NTF-Adjustable Arm Mount            | NTX-AA-BZ     |                   |                  |                   |       |                  |
| -                             | Single Square tenon Reducer_4" Pole | 79915         |                   |                  |                   |       |                  |
| -                             | Single Square tenon Reducer_5" Pole | 79916         |                   |                  |                   |       |                  |
| -                             | Twin Square tenon Reducer           | 79944A        |                   |                  |                   |       |                  |
| -                             | Triple Square tenon Reducer         | 79945A        |                   |                  |                   |       |                  |

| CAT # | Voltage   |
|-------|-----------|
| 0     | 120V-277V |
| 1     | 120V      |
| 2     | 208V      |
| 4     | 277V      |
| 5     | 480V      |
| H     | 347-480V  |

| INCANDESCENT, PAR, T8 and T12 Standard Output LED Solutions |                  |                      |
|-------------------------------------------------------------|------------------|----------------------|
| Qty                                                         | Existing Fixture | Solution             |
| 2                                                           | 2 - 4' T8 Lamp   | (2) LED11BDT8/G4/840 |
| -                                                           | A19              | LED6DA19/840         |
| -                                                           | PAR 38           | LED18C38W/3940/40    |
| -                                                           | A19 Enclosed     | LED15DA21/840        |

| Wells Fargo Exterior Lighting Spec V1                                                                                                                                                                                                                                                                                             |                                               |                                            |           |       |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------|--------------------------------------------|-----------|-------|
| Exterior ATM / Night Depositories                                                                                                                                                                                                                                                                                                 |                                               | Spec - H                                   | Spec - NH |       |
| ATM<br>*Minimum FC levels                                                                                                                                                                                                                                                                                                         | 5' circle                                     | 10 fc                                      | 10 fc     |       |
|                                                                                                                                                                                                                                                                                                                                   | 50' circle                                    | 2 fc                                       | 1 fc      |       |
|                                                                                                                                                                                                                                                                                                                                   | WF Parking areas within 60'                   | 2 fc                                       | 1 fc      |       |
|                                                                                                                                                                                                                                                                                                                                   | If within 10' of a corner:                    | 40' unobstructed along wall (For 50' calc) | 2 fc      | 1 fc  |
| Night Depositories<br>*Minimum FC levels                                                                                                                                                                                                                                                                                          | 5' circle                                     | 10 fc                                      | 10 fc     |       |
|                                                                                                                                                                                                                                                                                                                                   | 50' circle                                    | 2 fc                                       | 1 fc      |       |
|                                                                                                                                                                                                                                                                                                                                   | If within 10' of a corner:                    | 40' unobstructed along wall                | 2 fc      | 1 fc  |
|                                                                                                                                                                                                                                                                                                                                   | Vestibule Door with ATM<br>*Minimum FC levels | 5' circle                                  | 10 fc     | 10 fc |
| 50' circle                                                                                                                                                                                                                                                                                                                        |                                               | 2 fc                                       | 1 fc      |       |
| WF Parking areas within 60'                                                                                                                                                                                                                                                                                                       |                                               | 2 fc                                       | 1 fc      |       |
| If within 10' of a corner:                                                                                                                                                                                                                                                                                                        |                                               | 40' unobstructed along wall (For 50' Calc) | 2 fc      | 1 fc  |
| Inside the vestibule doors with ATM/MND<br>*Minimum FC levels                                                                                                                                                                                                                                                                     |                                               | All over the Vestibule                     | 10 fc     | 10 fc |
| All footcandle specs are minimum point values U.O.N.<br>All calculation points taken at 3' above finished grade<br>All the exterior fixtures are of 4000K.<br>Regulated States: California, District of Columbia, Florida, Georgia, Illinois, Kansas,Louisiana, Maryland, Nevada, New Jersey, New York, Oregon, Texas, Washington |                                               |                                            |           |       |

| Calculation Summary |             |       |       |       |      |         |         |            |
|---------------------|-------------|-------|-------|-------|------|---------|---------|------------|
| Label               | CalcType    | Units | Avg   | Max   | Min  | Avg/Min | Max/Min | Meter Type |
| AHD_5'              | Illuminance | Fc    | 68.45 | 86.5  | 53.2 | 1.29    | 1.63    | Horizontal |
| AHD_50'             | Illuminance | Fc    | 10.08 | 69.9  | 1.1  | 9.16    | 63.55   | Horizontal |
| ATM_5'              | Illuminance | Fc    | 62.65 | 110.8 | 22.0 | 2.85    | 5.04    | Horizontal |
| ATM_50'             | Illuminance | Fc    | 12.97 | 73.6  | 1.9  | 6.83    | 38.74   | Horizontal |



THIS IS A D SIZE SHEET. THE NOTED SCALE IS NOT VALID IF PRINTED AS ANY OTHER SIZE.



Southern Lighting Source  
800 Battery Avenue SE Suite 410  
Atlanta, GA

Calculated light levels are based on specific information that has been supplied to SLS. Any differences in luminaire installation, lighted area geometry and obstructions in the lighted area may produce different results from the predicted values. Normal tolerances of voltage, lamp output, and ballast and luminaire manufacture will affect results.

Ref: IES LM-61-1986  
Identifying Operating Factors for HLD Luminaires

Southern Lighting Source  
800 Battery Avenue SE Suite 410  
Atlanta, GA 30339

Designer: PV

Date:12-12-2022

SLS Drawing #: WF #140533 - Wilton Center 44 OLD RIDGEFIELD RD WILTON, CT US,AG

WF # 140533 - Wilton Center  
44 OLD RIDGEFIELD RD, WILTON, CT, US.  
Horizontal and Vertical Fc indicated  
Values at maintained output

Page 1 of 3



