


Bank of America[®]



EXTERIOR LIGHTING PROGRAM

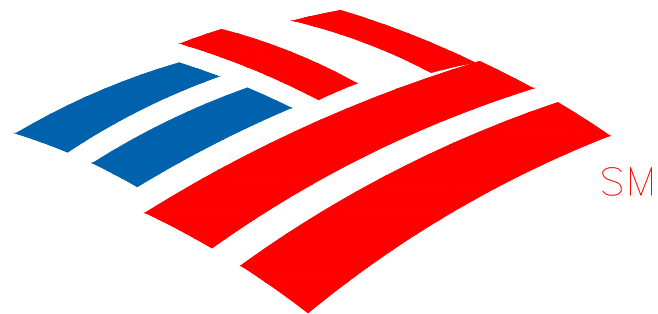

Facility Analysis + Engineering

Office: (972) 771-6038

1629 Smirl Drive, Suite 200, Heath, Texas 75032

www.gmr1.com

LUMINAIRE SCHEDULE					**SEE FIXTURE CLARIFICATION NOTE #9		(NFP) = NEW POLE (CBO) CONTROLLED BY OTHERS		** CONTRACTOR TO VERIFY MOUNTING ACCESSORIES BEFORE ORDERING**		
SYMBOL	QTY	LABEL	FIXTURE ARRANGEMENT	TOTAL FIXTURE COUNT	NEW POLE COUNT	FIXTURE TYPE / MOUNTING / MANUFACTURER	BUG RATING	MOUNTING HEIGHT	MOUNTING ACCESSORIES	NOTES	
	7	UDT1	SINGLE	7	-	(UDT1) L8X-70-30K / CANOPY MOUNT / CREE	B1-U0-G0	MATCH EXISTING	CS-LSA	REPLACE EXISTING FIXTURE	
	3	UDV1	SINGLE	3	-	(UDV1) L8X-30K-30K / CANOPY MOUNT / CREE	B1-U0-G0	MATCH EXISTING	CS-LSA	REPLACE EXISTING FIXTURE	
	2	UDV2	SINGLE	2	-	(UDV2) L8X-30K-30K / CANOPY MOUNT / CREE	B1-U0-G0	8' AFG	CS-LSA	ADD NEW FIXTURE - MATCH EXISTING CANOPY HEIGHT	
	2	UDW1	SINGLE	2	-	(UDW1) L8X-38L-30K / CANOPY MOUNT / CREE	B1-U0-G0	MATCH EXISTING	CS-LSA	REPLACE EXISTING FIXTURE	
	1	UHM1	DOUBLE (2@90°)	2	-	(UHM1) DSQ-L-8-30K-30K-4M-UL-NM-B2 / POLE MOUNT / CREE	B4-U0-G3	MATCH EXISTING	DSQ-ML-B-0A-B2	REPLACE EXISTING FIXTURE	
	1	USA1	SINGLE	1	-	(USA1) SEC-EDG-25-WM-02-E-UL-B2-350-30K / WALL MOUNT / CREE	B3-U0-G3	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	2	USF1	SINGLE	2	-	(USF1) SEC-EDG-3M-WM-02-E-UL-B2-525-30K / WALL MOUNT / CREE	B1-U0-G1	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	USH1	SINGLE	1	-	(USH1) SEC-EDG-4M-WM-02-E-UL-B2-350-30K / WALL MOUNT / CREE	B1-U0-G1	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	USI1	SINGLE	1	-	(USI1) SEC-EDG-4M-WM-02-E-UL-B2-700-30K / WALL MOUNT / CREE	B1-U0-G1	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	US2	SINGLE	1	-	(US2) SEC-EDG-4M-WM-02-E-UL-B2-700-30K / WALL MOUNT / CREE	B1-U0-G1	11' - 6" AFG	-	ADD NEW FIXTURE	
	3	USK1	SINGLE	3	-	(USK1) SEC-EDG-4M-WM-04-E-UL-B2-525-30K / WALL MOUNT / CREE	B2-U0-G2	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	USK2	SINGLE	1	-	(USK2) SEC-EDG-4M-WM-04-E-UL-B2-525-30K / WALL MOUNT / CREE	B2-U0-G2	11' AFG	-	ADD NEW FIXTURE	
	1	YB1	SINGLE	1	-	EXISTING POLE FIXTURE	-	-	-	OUT OF SCOPE	
	2	ZC1	SINGLE	2	-	BOX DRIVE UP ATM #1 FIXTURE (GEWH4848B4T)	-	-	-	OUT OF SCOPE	

CONTRACTOR RESPONSIBILITY NOTES:

- CONTRACTOR SHALL BE RESPONSIBLE FOR PERMITTING, INCLUDING COORDINATION WITH THE LOCAL JURISDICTION AND ANY ASSOCIATED PERMIT FEES OR PROCESSING. CONTRACTOR SHALL NOTIFY GMR UPON RECEIPT OF PERMIT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PERMITTING DOCUMENTS THAT ARE NOT INCLUDED IN THE LIGHTING DESIGN PACKAGE. THESE INCLUDE, BUT ARE NOT LIMITED TO, STAMPED ELECTRICAL DRAWINGS, STAMPED POLE BASE DRAWINGS, AND PROFESSIONAL SURVEY.
- SHOULD STAMPED PHOTOGRAPHIC DRAWINGS BE REQUIRED, CONTRACTOR SHALL ENGAGE LOCAL ENGINEER OR LIGHTING PROFESSIONAL SURVEY.
- DISCOVERIES REQUIRED TO PROVIDE STAMP ON GMR PHOTOGRAPHIC DOCUMENTS.
- CONTRACTOR SHALL PROVIDE THE BANNING CENTER NOTIFICATION AT LEAST ONE WEEK IN ADVANCE OF VISITING SITES OR STARTING WORK.
- CONTRACTOR SHALL VERIFY VOLTAGE REQUIREMENTS FOR FIXTURES PRIOR TO PLACEMENT OF FIXTURE ORDERS.
- CONTRACTOR TO VERIFY LIGHTING CONTROLS PRIOR TO BEGINNING CONSTRUCTION. SEE LIGHTING CONTROL NOTES.
- CONTRACTOR SHALL RECEIVE FORMAL APPROVAL FROM GMR ON ANY FIXTURE MODIFICATIONS OR VARIATIONS FROM THE LUMINAIRE SCHEDULE.
- CONTRACTOR SHALL VERIFY EXISTING AND PROPOSED FIXTURE MOUNTING CONDITIONS IN FIELD. ANY SPECIAL MOUNTING HARDWARE NEEDED FOR PROPOSED FIXTURES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR SHALL SUPPLY ALL NEW LIGHT POLES. NEW LIGHT POLES SHALL MATCH EXISTING CONDITIONS ON SITE FOR POLE TYPE AND PAINT COLOR.
- CONTRACTOR SHALL ORDER ALL FIXTURES FROM BORDER STATES IN ACCORDANCE WITH BANK OF AMERICA NATIONAL ACCOUNT CONTRACT NATIONAL ACCOUNT NOTICES DEMANDS AT BORDER STATES (TEXAS OR TEXAS 37) SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR SHALL PROVIDE ALL NECESSARY PATCHING OR REPAIRING FOR HOLES, REMOVED, OR REPLACED FIXTURES.
- CONTRACTOR SHALL REPAIR ANY DISTURBED AREAS BACK TO EXISTING CONDITION INCLUDING PAVED AREAS, LANDSCAPED AREAS, ETC.
- CONTRACTOR SHALL VERIFY AND DOCUMENT COMPLETED WORK DURING NIGHT HOURS. ALL FIXTURES MUST BE FUNCTIONAL DURING NIGHT HOURS PRIOR TO SCHEDULING A FINAL SURVEY WITH GMR.
- CONTRACTOR SHALL PROVIDE BEFORE AND AFTER NIGHT TIME PHOTOS OF THE SITE.
- CONTRACTOR SHALL UTILIZE THE "JOB LEAD" PROTECTIVE SITE SURVEY POINT TO DOCUMENT THE EXACT DETAILS OF EACH FIXTURE BEING REMOVED FOR REPAIR AND ENERGY SAVINGS CALCULATION PURPOSES.
- CONTRACTOR SHALL RECEIVE A PURCHASE ORDER FROM GMR UPON FINAL SURVEY FOR ANY REMAINING ITEMS TO BE COMPLETED.

CONTROLS & ADDITIONAL NOTES:

LIGHTING CONTROL NOTES:

THE CONTRACTOR SHALL VERIFY THE CONTROLS FOR ALL EXTERIOR LIGHTING AND ATM/HAZARD INTERIOR LOBBIES ON THE SITE (EXCLUDING SIGNAGE) AND ADJUST ACCORDING TO THE FOLLOWING:

- IC3 CONTROL:**
CONTRACTOR SHALL VERIFY THAT EXTERIOR LIGHTING CIRCUITS ARE CONTROLLED BY THE CORRECT IC3 CIRCUIT. WHERE EXTERIOR LIGHTING IS INCLUDED ON CONTROL CIRCUITS FOR INTERIOR SYSTEMS, INTERIOR LIGHTING, OR EXTERIOR SIGNAGE, CONTRACTOR SHALL ADJUST EXTERIOR LIGHTING TO THE CORRECT CONTROL CIRCUIT AS REQUIRED.
- PHOTOCELL CONTROL:**
CONTRACTOR SHALL REPLACE EXISTING PHOTOCELLS WITH NEW AND INSTALL IN A LOCATION BEST SUITED TO PROVIDE APPROPRIATE LIGHT EXPOSURE SUCH THAT EXTERIOR LIGHTS ARE ON DURING DARKNESS.
- TIME CLOCK CONTROL:**
CONTRACTOR SHALL VERIFY LOCATION OF TIME CLOCK. IF TIME CLOCK IS IN ELECTRICAL ROOM ADJACENT WITH IC3 CONTROL, CONTRACTOR SHALL ADJUST CIRCUIT TO BE CONTROLLED BY IC3 EXTERIOR LIGHTING CONTROLS. IF TIME CLOCK IS IN A REMOTE LOCATION NOT IN CLOSE PROXIMITY TO THE IC3 CONTROL, CONTRACTOR SHALL VERIFY TIME CLOCK IS SET PROPERLY AND LEAVE CIRCUIT ON TIME CLOCK CONTROL.
- MANUAL CONTROL:**
CONTRACTOR SHALL VERIFY THAT NO EXTERIOR LIGHTING IS CONTROLLED MANUALLY. IF ANY EXTERIOR LIGHTING IS ON A MANUALLY CONTROLLED CIRCUIT, CONTRACTOR SHALL ADJUST TO BE CONTROLLED BY PHOTOCELL OR IC3, WHICHEVER IS MOST ECONOMICALLY ACCOMMODATED.

ADDITIONAL CONTRACTOR NOTES:

CONSTRUCTION COMPLETION VERIFICATION:

UPON COMPLETION OF THE WORK, THE CONTRACTOR SHALL PROVIDE VERIFICATION IN WRITING TO THE BANK OF AMERICA FIRM THAT ALL WORK IS COMPLETE ACCORDING TO THE CONSTRUCTION DOCUMENTS, AND THAT ALL EXTERIOR LIGHTING IS FUNCTIONING DURING NIGHTTIME HOURS. COMPLETION PHOTOS, TAKEN AT NIGHT, SHALL BE PROVIDED IN THE FOLLOWING FORMAT:

PROVIDE A SINGLE DOCUMENT CONTAINING THE FOLLOWING:

- SITE PHOTOS FROM ALL SIDES OF BUILDING
- MINIMUM OF 3 PHOTOS OF EACH COMPLIANCE AREA (ATMS), AFTER-HOUR DEPOSITORIES, ASSOCIATE ENTRY FROM DIFFERENT ANGLES
- MINIMUM OF 2 PHOTOS OF ALL NON-COMPLIANCE AREAS FROM DIFFERENT ANGLES

FIXTURE CLARIFICATION NOTES:

- OUT OF SCOPE: EXISTING FIXTURES TO REMAIN ON SITE WITHOUT MODIFICATION. NO ACTION REQUIRED UNLESS NOTED OTHERWISE.
- REMOVE AND PATCH: EXISTING FIXTURES TO BE FULLY REMOVED AND ANY PAINTING, PATCHING OR ELECTRICAL WORK NEEDED IS TO BE ASSESSED AND PERFORMED BY CONTRACTOR.
- REPLACE EXISTING FIXTURE: EXISTING FIXTURE TO BE FULLY REMOVED AND REPLACED IN THE SAME LOCATION WITH A NEW FIXTURE. CONTRACTOR TO VERIFY IF POLE AND/OR POLE BASE IS SUFFICIENT FOR THE NEW FIXTURES. ANY PAINTING, PATCHING OR ELECTRICAL WORK NEEDED IS TO BE ASSESSED AND PERFORMED BY CONTRACTOR.
- ADD NEW FIXTURE: NEW FIXTURES TO BE ADDED. ANY PAINTING, PATCHING OR ELECTRICAL WORK NEEDED TO BE ASSESSED AND PERFORMED BY CONTRACTOR.
- ADD NEW POLE & FIXTURE: A NEW POLE AND FIXTURE TO BE ADDED. CONTRACTOR TO SPECIFY POLE TO MATCH EXISTING TYPE AND COLOR AND, IF NOT PROVIDED, POLE BASE DATA FOR NEW POLE LOCATIONS. CONTRACTOR TO VERIFY IF POLE AND POLE BASE IS SUFFICIENT FOR THE HEIGHT, LOCATION AND FIXTURE SPECIFIED.
- GMR DOES NOT SPECIFY MOUNTING HARDWARE FOR ANY SPECIFIED FIXTURES. CONTRACTOR IS TO WORK WITH DISTRIBUTOR AND/OR MANUFACTURER ON A CASE BY CASE BASIS TO IDENTIFY AND ORDER REQUIRED MOUNTING HARDWARE.
- CONTRACTOR TO VERIFY WHETHER EXISTING WIRING LOCATIONS OR THE ADDITION OF WIRING FOR NEW FIXTURE LOCATIONS IS SUFFICIENT FOR THE DESIGNATED FIXTURE LOCATION.
- CONTRACTOR TO SPECIFY POLE COLOR AND TYPE PRIOR TO ORDERING.
- CONTRACTOR TO CONFIRM PRIOR TO ORDERING.

GENERAL NOTES:

- EXISTING CONDITIONS SHOWN ON THE DRAWINGS ARE BASED ON A LIMITED AMOUNT OF INFORMATION AVAILABLE TO THE ENGINEER. ALL SUCH CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO SUBMITTING THE BID AND ADJUSTED IF NECESSARY. NO ADDITIONAL COMPENSATION SHALL BE AWARDED AFTER AWARDING A BID FOR ANY EQUIPMENT, MATERIAL OR LABOR REQUIRED TO REWORK OR OTHERWISE MODIFY EXISTING CONDITIONS.
- THIS LIGHTING DESIGN IS BASED ON THE BANK'S CURRENT SECURITY STANDARDS. THE BANK'S CURRENT SECURITY POLICY FOR EXTERIOR ATM AND AFTER-HOUR DEPOSITORIES AND BANK GUIDELINES FOR NON-SECURITY COMPLIANCE ZONES.
- TRIM ALL TREES AND LANDSCAPING FROM AROUND THE PERIMETER OF THE BUILDING AND THE 6' RADIUS AROUND ALL ATMS AND A RADIUS OF 5' AROUND ALL AFTER-HOUR DEPOSITORIES. CONSIDERATION MUST BE GIVEN TO TREES AND LANDSCAPING AND STATE OF FULL FOLIAGE AND FUTURE GROWTH. ALL LANDSCAPING WORK WILL BE PERFORMED BY OTHERS WITH A SEPARATE PERMIT (IF REQUIRED).
- ALL MOUNTING HEIGHTS ARE INTENDED TO THE BOTTOM OF THE FIXTURE.
- CONTRACTOR TO FIELD VERIFY FIXTURE PLACEMENT DIMENSIONS PRIOR TO CONSTRUCTION.
- DARKENING PROVIDED IS FOR PROPOSED FIXTURE LOCATIONS ONLY, UNLESS OTHERWISE NOTED ON THE DRAWING. THE CONTRACTOR SHALL ATTEMPT TO ELIMINATE THE USE OF EXPOSED CONDUIT WHERE POSSIBLE. IF EXPOSED CONDUIT IS NECESSARY, THE CONTRACTOR SHALL VERIFY USE WITH PROJECT MANAGER.
- ALL EXISTING LIGHTS SHALL BE REPLACED WITH LED LIGHTS AND ALL PROPOSED LIGHTS WILL ALSO BE LED, UNLESS OTHERWISE NOTED.
- ALL FIXTURES ARE TO BE MOUNTED ABOVE FINISH GRADE.
- UNLESS OTHERWISE NOTED, MATCH EXISTING POLE BASES.

SITE ABBREVIATIONS:

- PL = PROPERTY LINE
AFG = ABOVE FINISHED GRADE
FC = FOOT CANDLE
CBO = CONTROLLED BY OTHERS
AHD = AFTER HOUR DEPOSITORY


NOTE: THIS LIGHTING PLAN ILLUSTRATES ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA UNDER CONTROLLED CONDITIONS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY OF NORTH AMERICA (IESNA) APPROVED METHODS. ACTUAL SITE ILLUMINATION LEVELS AND PERFORMANCE OF LUMINAIRES MAY VARY DUE TO VARIATIONS IN WEATHER, ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER RELATED VARIABLE FIELD CONDITIONS.

SITE NOTES:


-

EXISTING CONDITIONS:

- EXISTING POLES - DECORATIVE - STEEL
- EXISTING POLE BASES - 5"
- EXISTING DRIVE THRU CEILING - N/A

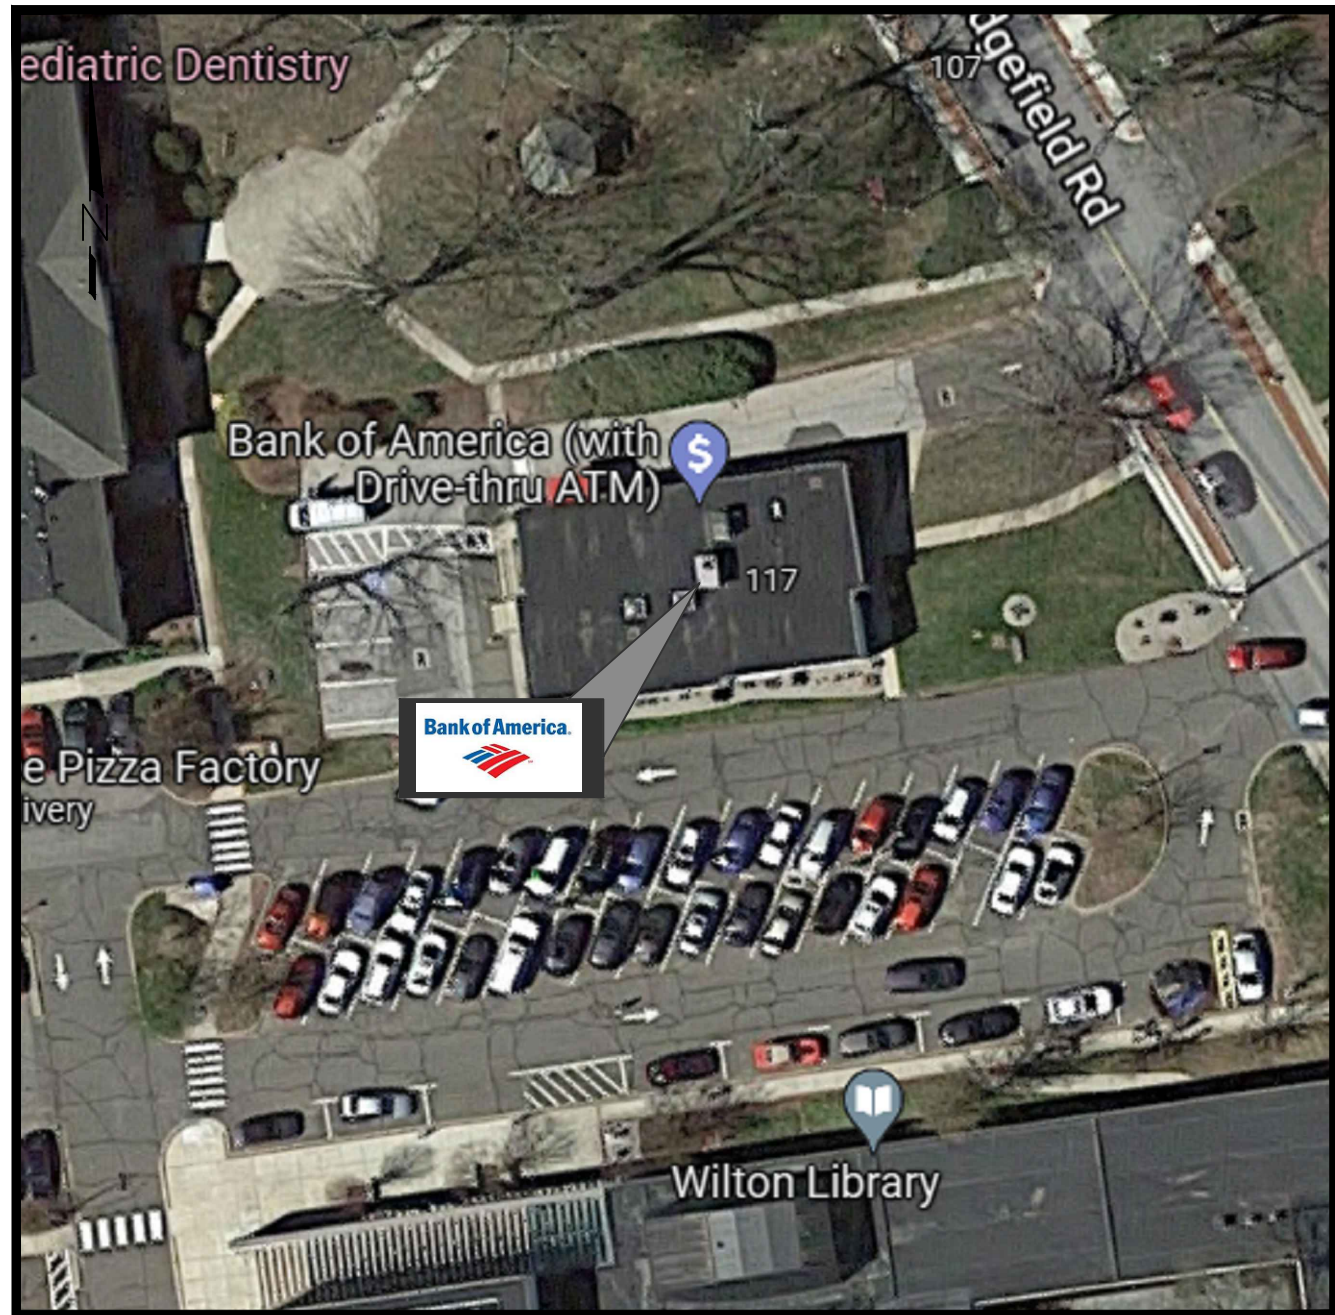

VICINITY MAP

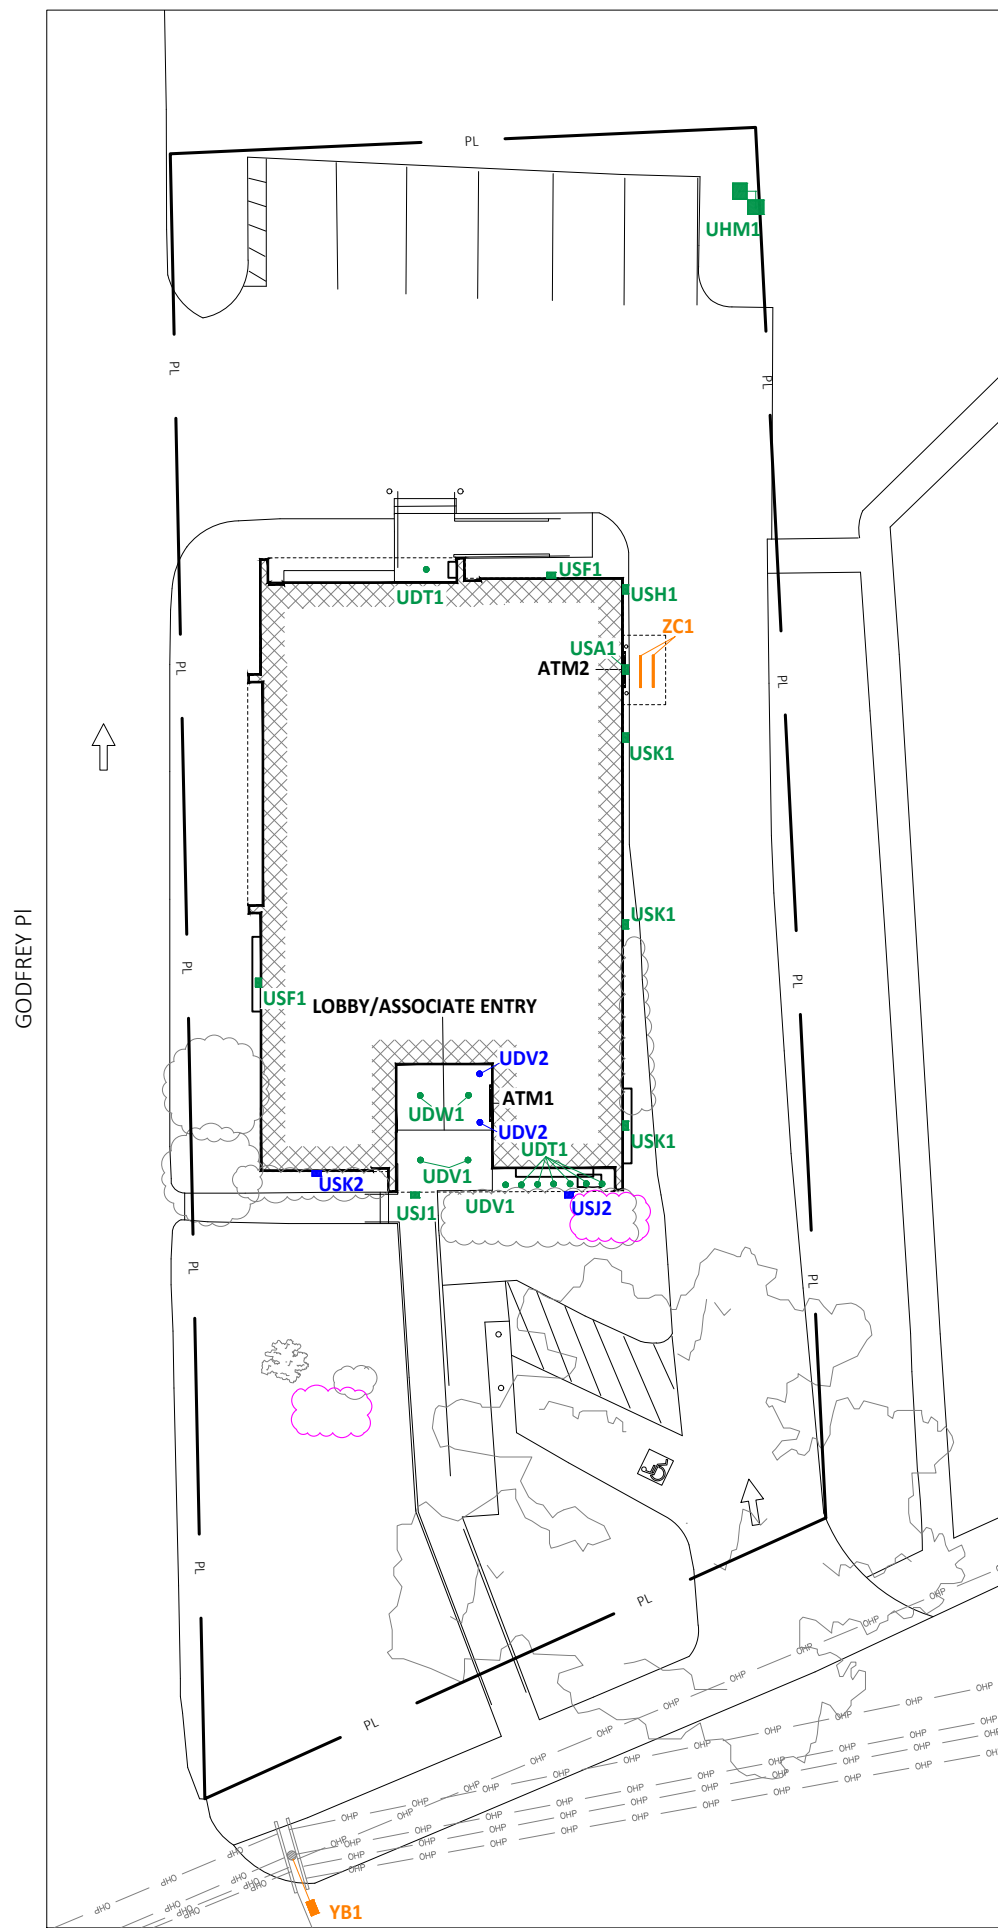


SCALE: 1/2" = 1'-0"

Bank of America[®]



BLUE = NEW FIXTURE
GREEN = EXISTING FIXTURE LOCATION TO BE REPLACED
ORANGE = EXISTING FIXTURE TO REMAIN
TURQUOISE = FIXTURE TO BE REMOVED
PINK = REPLACE WITH NEW POLE AT NEW HEIGHT
— = INDICATES NEW SECURITY FENCE
— PL — = PROPERTY LINE BASED ON COUNTY APPRAISAL INFORMATION



v4 220623

REVISION NO.	DESCRIPTION	REVISED BY
1		KRM
2		KRM
3		KRM
4		KRM
5		KRM
6		KRM
7		KRM
8		KRM
9		KRM
10		KRM
11		KRM
12		KRM
13		KRM
14		KRM
15		KRM
16		KRM
17		KRM
18		KRM
19		KRM
20		KRM
21		KRM
22		KRM
23		KRM
24		KRM
25		KRM
26		KRM
27		KRM
28		KRM
29		KRM
30		KRM
31		KRM
32		KRM
33		KRM
34		KRM
35		KRM
36		KRM
37		KRM
38		KRM
39		KRM
40		KRM
41		KRM
42		KRM
43		KRM
44		KRM
45		KRM
46		KRM
47		KRM
48		KRM
49		KRM
50		KRM
51		KRM
52		KRM
53		KRM
54		KRM
55		KRM
56		KRM
57		KRM
58		KRM
59		KRM
60		KRM
61		KRM
62		KRM
63		KRM
64		KRM
65		KRM
66		KRM
67		KRM
68		KRM
69		KRM
70		KRM
71		KRM
72		KRM
73		KRM
74		KRM
75		KRM
76		KRM
77		KRM
78		KRM
79		KRM
80		KRM
81		KRM
82		KRM
83		KRM
84		KRM
85		KRM
86		KRM
87		KRM
88		KRM
89		KRM
90		KRM
91		KRM
92		KRM
93		KRM
94		KRM
95		KRM
96		KRM
97		KRM
98		KRM
99		KRM
100		KRM



Facility Analysis + Engineering


Wilton
CT2-255
117 Old Ridgefield Rd
Wilton, CT

SITE PLAN

DESIGN BY:	JDH	DRAWN BY:	RCS
REVIEWED BY:	AJH	APPROVED BY:	KRM
SHEET NO.			

COVER

THIS PLAN SET IS PROPRIETARY AND CONFIDENTIAL INFORMATION OF THE BANK AND THE USE OF THIS DESIGN IS PROHIBITED WITHOUT THE EXPRESS PERMISSION OF THE BANK

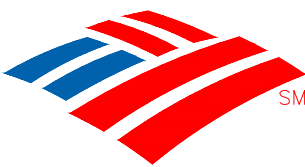

BLUE = NEW FIXTURE
GREEN = EXISTING FIXTURE LOCATION TO BE REPLACED
ORANGE = EXISTING FIXTURE TO REMAIN
TURQUOISE = FIXTURE TO BE REMOVED
PINK = REPLACE WITH NEW POLE AT NEW HEIGHT
— = INDICATES NEW SECURITY FENCE
— PL — = PROPERTY LINE BASED ON COUNTY APPRAISAL INFORMATION



N.T.S.

v4 220623

3		
2		
1		KRM
REVISION NO.	DESCRIPTION	REVISED BY




Wilton
CT2-255
117 Old Ridgefield Rd
Wilton, CT

SITE DETAILS

DESIGN BY:	JDH	DRAWN BY:	RCS
REVIEWED BY:	AJH	APPROVED BY:	KRM


SHEET NO.	LU-1
-----------	------

COMPLIANCE AREA

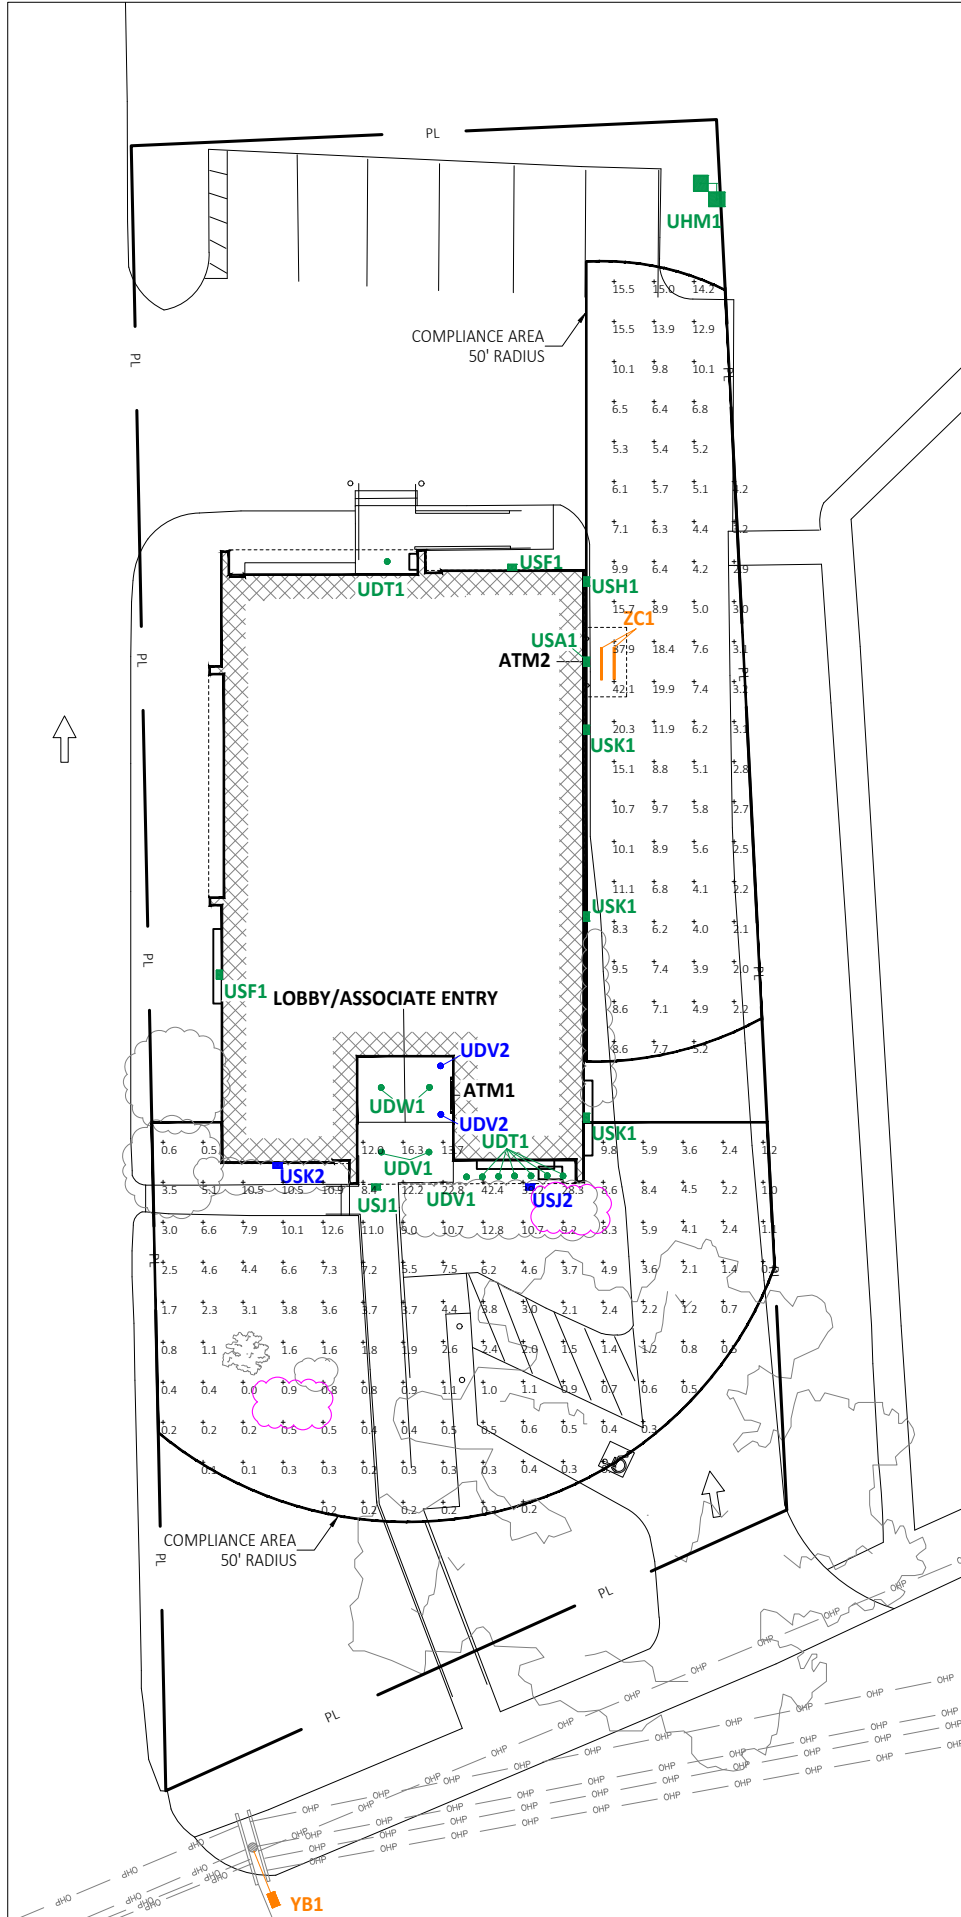


SCALE: 1/2" = 1'-0"

FULL SITE CALCS

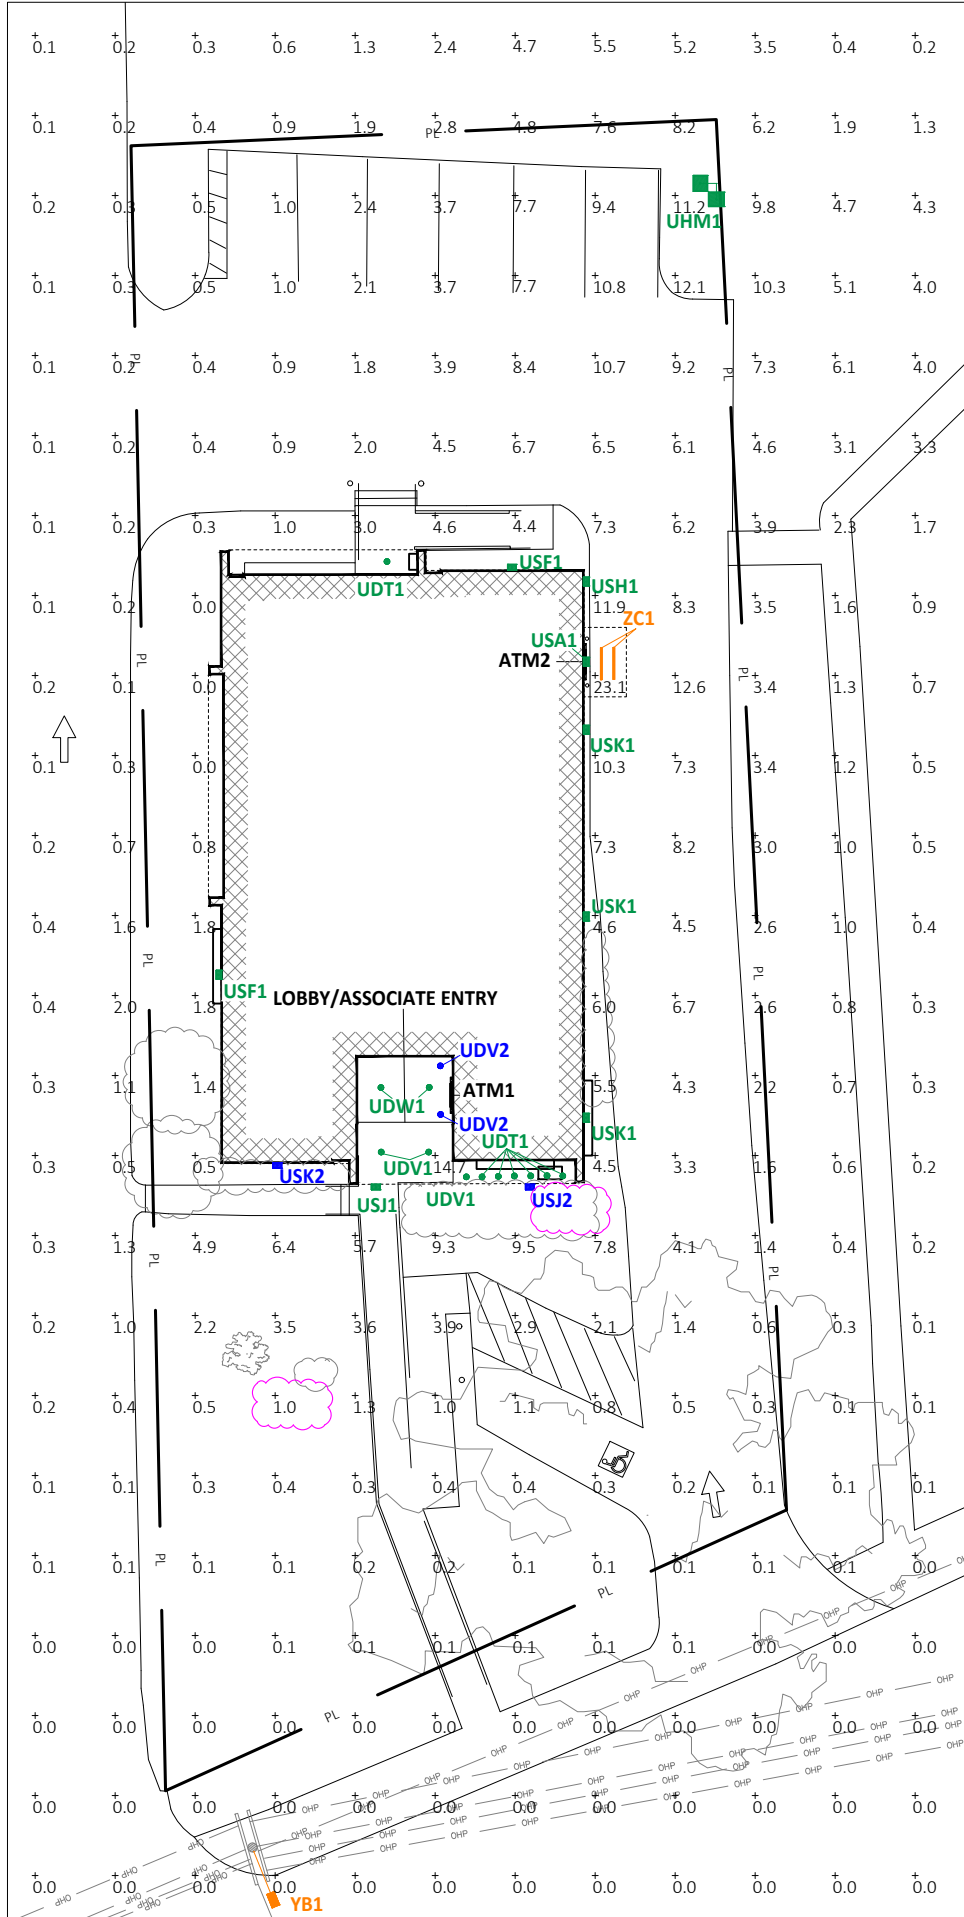


SCALE: 1/2" = 1'-0"

LANDSCAPE

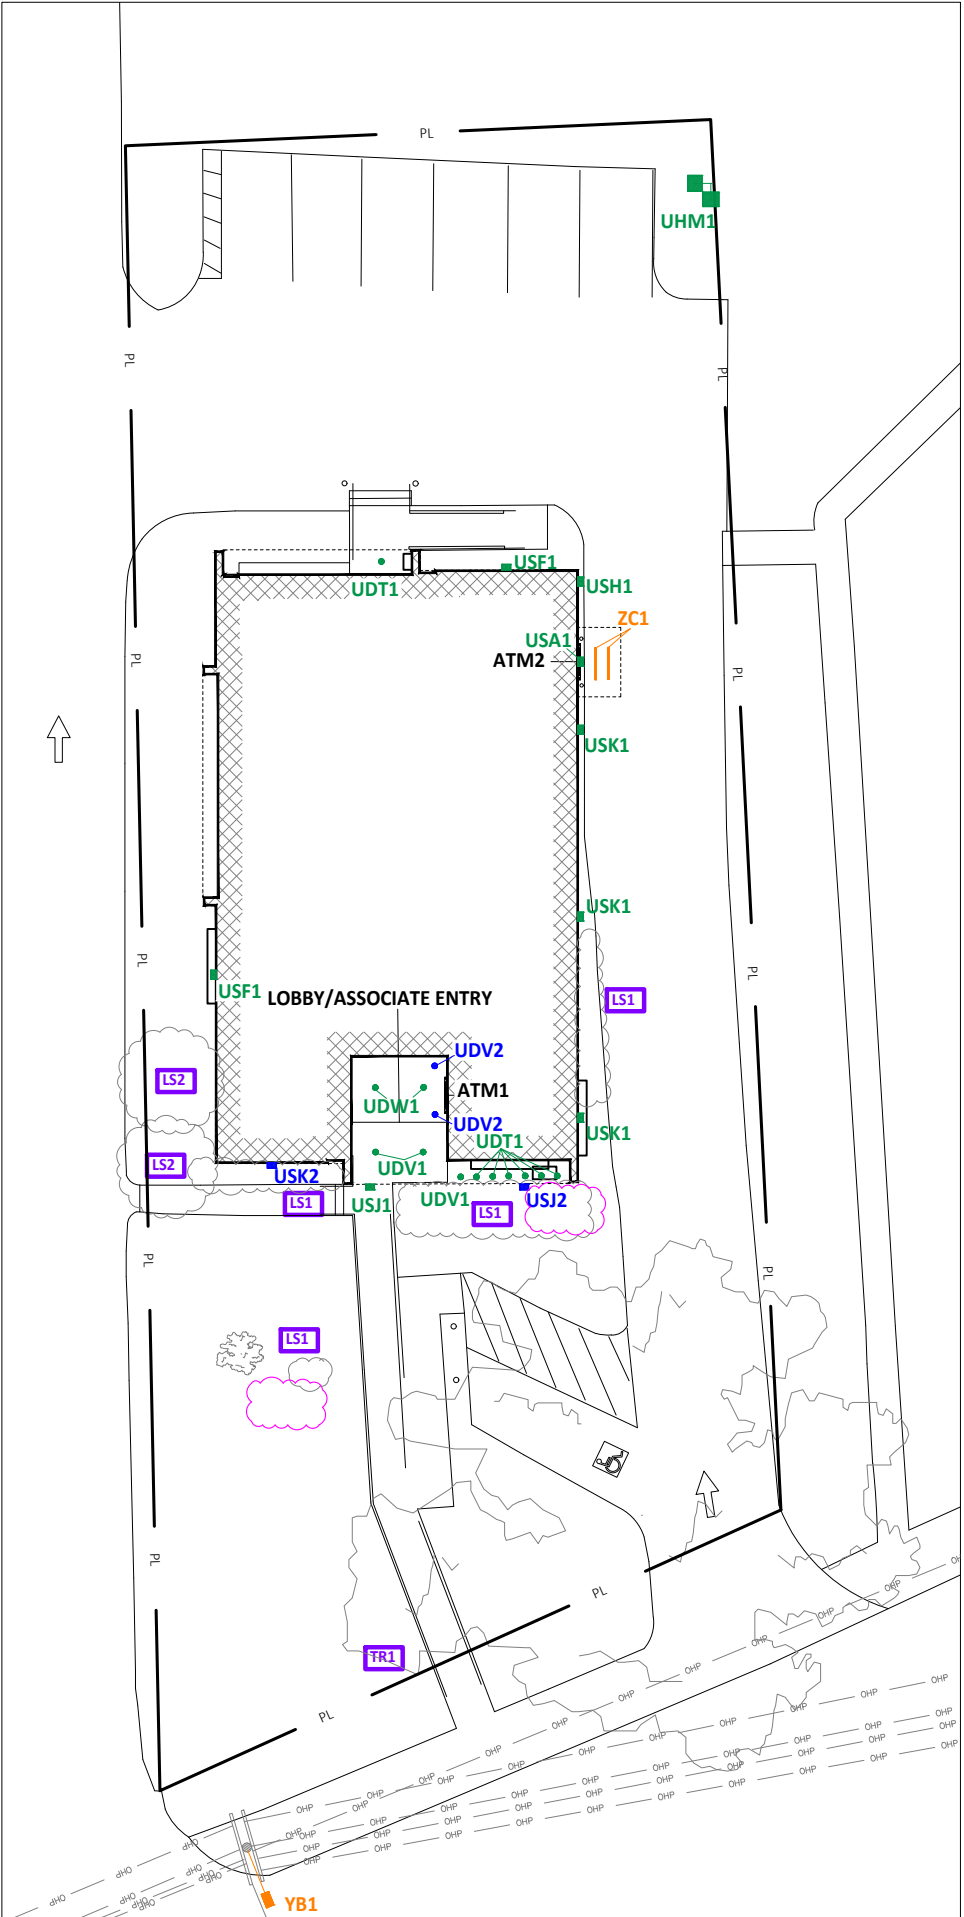

SCALE: 1/2" = 1'-0"

DIMENSIONS

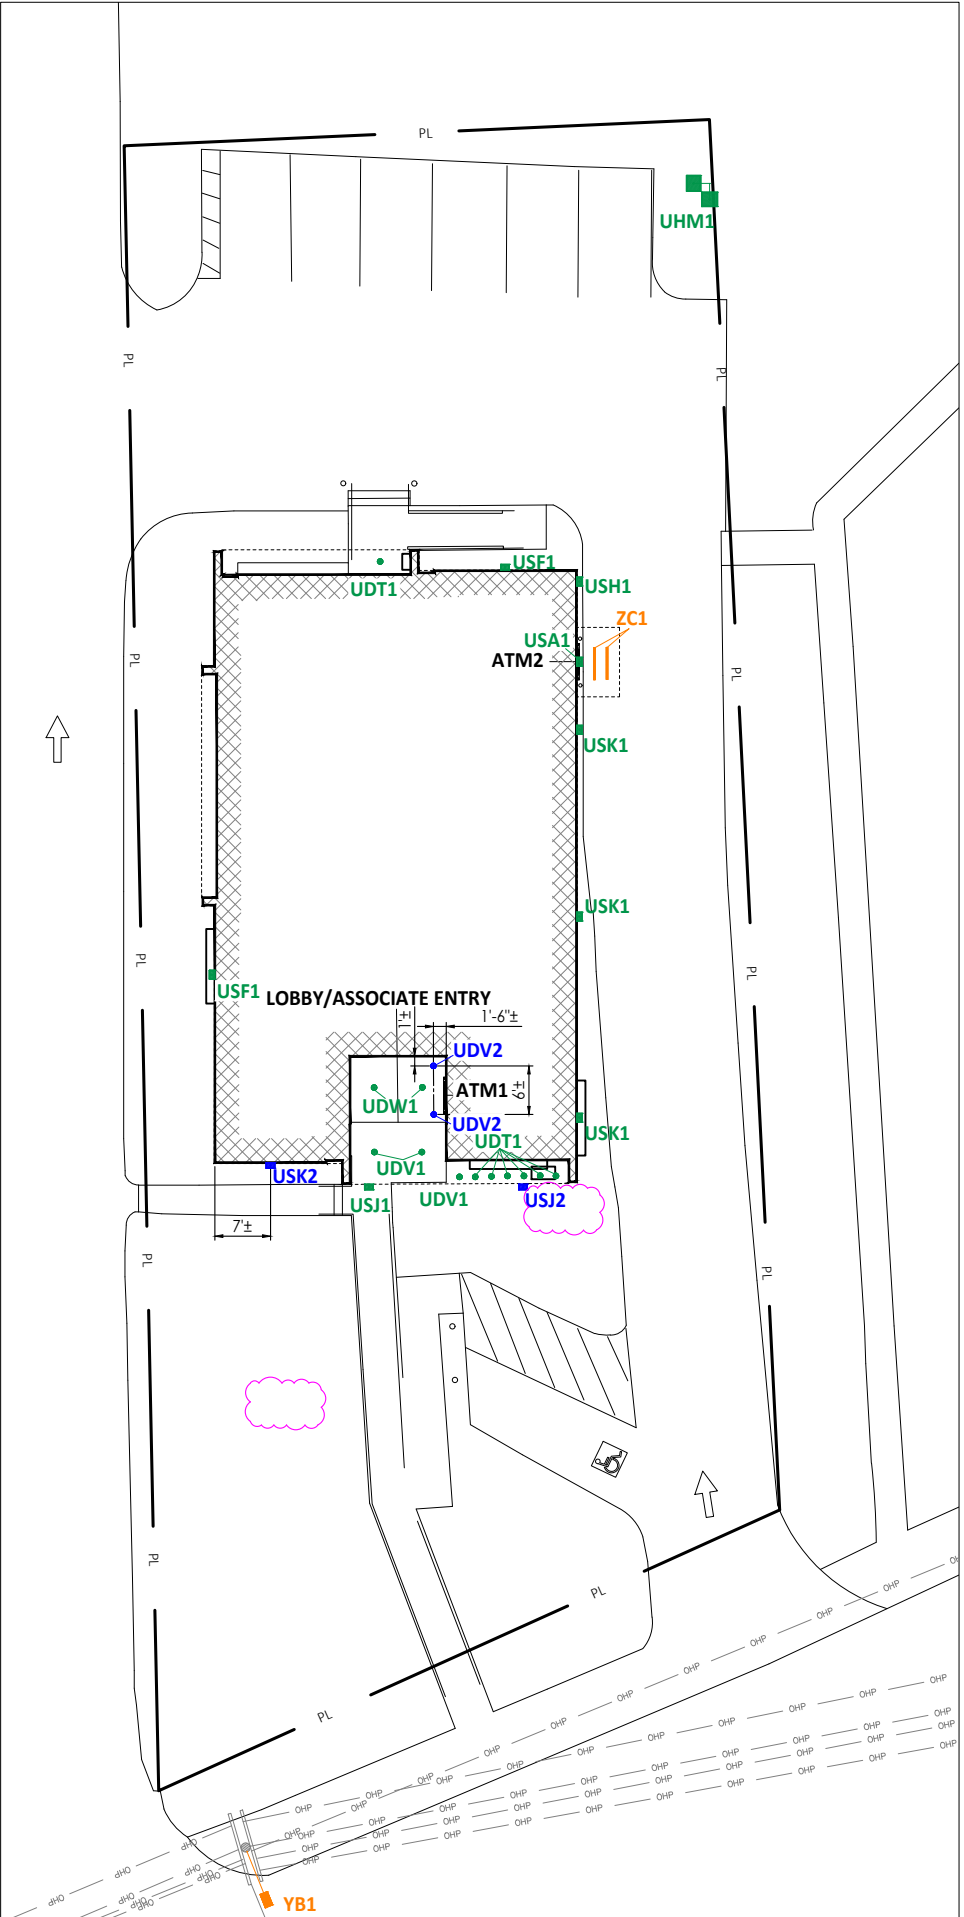

SCALE: 1/2" = 1'-0"

QTY	LABEL	NOTES	MOUNTING HEIGHT
7	UDT1	REPLACE EXISTING FIXTURE	MATCH EXISTING
3	UDV1	REPLACE EXISTING FIXTURE	MATCH EXISTING
2	UDV2	ADD NEW FIXTURE - MATCH EXISTING CANOPY HEIGHT	11' AFG
2	UDV1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	UHM1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USA1	REPLACE EXISTING FIXTURE	MATCH EXISTING
2	USF1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USH1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USI1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USI2	ADD NEW FIXTURE	11' AFG
3	USK1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USK2	ADD NEW FIXTURE	11' AFG
1	YB1	OUT OF SCOPE	-
2	ZC1	OUT OF SCOPE	-

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
ATM2 50' @ 36"	Illuminance	Fc	8.53	42.1	2.0	4.27	21.05
LOBBY 50' @ 36"	Illuminance	Fc	4.31	42.4	0.0	N.A.	N.A.

NOTES:
1. READINGS ARE MEASURED AT 36" (3') ABOVE GRADE.

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
FULL SITE @ GRADE	Illuminance	Fc	2.25	23.1	0.0	N.A.	N.A.

NOTES:
1. THE SCOPE OF WORK FOR THIS PROJECT IS LIMITED TO EXTERIOR LIGHTING RENOVATIONS AS SHOWN ON THE PLANS.
2. REFERENCE THE LUMINAIRE SCHEDULE FOR ADDITIONAL LIGHT FIXTURE INFORMATION.

SITE NOTES:
1. EXISTING POLES - DECORATIVE - STEEL 2. EXISTING POLE BASES - 12" 3. EXISTING DRIVE THRU CEILING - N/A
EXISTING CONDITIONS:
1. EXISTING POLES - DECORATIVE - STEEL 2. EXISTING POLE BASES - 12" 3. EXISTING DRIVE THRU CEILING - N/A

SYMBOL	QTY	NOTES
TR1	1	TRIM TREE UP TO 15' AND AWAY FROM LIGHT FIXTURE TO ENSURE THAT IT DOES NOT INTERFERE WITH INTERFERED ILLUMINATION
LS1	-	TRIM LANDSCAPING DOWN TO 30"
LS2	2	REMOVE LANDSCAPING AND REPLACE WITH LANDSCAPING THAT CAN BE MAINTAINED AT 30"

NOTE: THIS LIGHTING PLAN ILLUSTRATES ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA UNDER CONTROLLED CONDITIONS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY OF NORTH AMERICA (IESNA) APPROVED METHODS. ACTUAL SITE ILLUMINATION LEVELS AND PERFORMANCE OF LUMINAIRES MAY VARY DUE TO VARIATIONS IN WEATHER, ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER RELATED VARIABLE FIELD CONDITIONS.