



Proposed Exterior Security Lighting

Bank of America: 117 Old Ridgefield Rd Wilton, CT

Applicant: Andrew Rainone- Horton Group LLC


Contact: arainone@hortongroupllc.com

To whomever this may concern, on behalf of Bank of America, we request the town review our security lighting design. The purpose of the project will be to improve public safety, and the safety of staff members/bank vendors during hours of darkness. As well as meeting Bank of America security standards, as this property has a 24hr ATM and night depository. Our lighting design has been revised several times in order to reflect the comments of the VDDAC and we have received formal approval.

Summary of work:

- Install 2 new wall mount fixtures on the front of the building
- Install 2 new recessed can above the walk-up ATM
- Replace 8 existing wall mount fixtures
- Replace 5 existing recessed cans with LED
- Replace 2 existing light pole fixtures with LED
- All lighting to be 3000k per VDDAC
- All lighting to be on lighting controls, on from dusk until dawn

Bank of America[®]

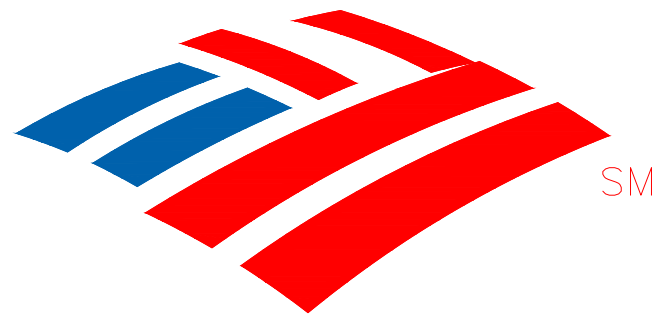

EXTERIOR LIGHTING PROGRAM



Facility Analysis + Engineering

Office: (972) 771-6038

1629 Smirl Drive, Suite 200, Heath, Texas 75032

www.gmr1.com

LUMINAIRE SCHEDULE					**SEE FIXTURE CLARIFICATION NOTE #9		(NFP) = NEW POLE (CBO) CONTROLLED BY OTHERS		** CONTRACTOR TO VERIFY MOUNTING ACCESSORIES BEFORE ORDERING**		
SYMBOL	QTY	LABEL	FIXTURE ARRANGEMENT	TOTAL FIXTURE COUNT	NEW POLE COUNT	FIXTURE TYPE / MOUNTING / MANUFACTURER	BUG RATING	MOUNTING HEIGHT	MOUNTING ACCESSORIES	NOTES	
	7	UDT1	SINGLE	7	-	(UDT1) L8X-70-30K / CANOPY MOUNT / CREE	B1-U0-G0	MATCH EXISTING	CS-LSA	REPLACE EXISTING FIXTURE	
	3	UDV1	SINGLE	3	-	(UDV1) L8X-30K-30K / CANOPY MOUNT / CREE	B1-U0-G0	MATCH EXISTING	CS-LSA	REPLACE EXISTING FIXTURE	
	2	UDV2	SINGLE	2	-	(UDV2) L8X-30K-30K / CANOPY MOUNT / CREE	B1-U0-G0	8' AFG	CS-LSA	ADD NEW FIXTURE - MATCH EXISTING CANOPY HEIGHT	
	2	UDW1	SINGLE	2	-	(UDW1) L8X-30K-30K / CANOPY MOUNT / CREE	B1-U0-G0	MATCH EXISTING	CS-LSA	REPLACE EXISTING FIXTURE	
	1	UHM1	DOUBLE (2@90°)	2	-	(UHM1) DSQ-L-8-30K-30K-4M-UL-NM-B2 / POLE MOUNT / CREE	B4-U0-G3	MATCH EXISTING	DSQ-ML-B-DA-B2	REPLACE EXISTING FIXTURE	
	1	USA1	SINGLE	1	-	(USA1) SEC-EDG-25-WM-Q2-E-UL-B2-350-30K / WALL MOUNT / CREE	B3-U0-G3	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	2	USF1	SINGLE	2	-	(USF1) SEC-EDG-3M-WM-Q2-E-UL-B2-525-30K / WALL MOUNT / CREE	B1-U0-G1	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	USH1	SINGLE	1	-	(USH1) SEC-EDG-4M-WM-Q2-E-UL-B2-350-30K / WALL MOUNT / CREE	B1-U0-G1	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	USI1	SINGLE	1	-	(USI1) SEC-EDG-4M-WM-Q2-E-UL-B2-700-30K / WALL MOUNT / CREE	B1-U0-G1	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	US2	SINGLE	1	-	(US2) SEC-EDG-4M-WM-Q2-E-UL-B2-700-30K / WALL MOUNT / CREE	B1-U0-G1	11' - 6" AFG	-	ADD NEW FIXTURE	
	3	USK1	SINGLE	3	-	(USK1) SEC-EDG-4M-WM-Q2-E-UL-B2-525-30K / WALL MOUNT / CREE	B2-U0-G2	MATCH EXISTING	-	REPLACE EXISTING FIXTURE	
	1	USK2	SINGLE	1	-	(USK2) SEC-EDG-4M-WM-Q4-E-UL-B2-525-30K / WALL MOUNT / CREE	B2-U0-G2	11' AFG	-	ADD NEW FIXTURE	
	1	YB1	SINGLE	1	-	EXISTING POLE FIXTURE	-	-	-	OUT OF SCOPE	
	2	ZC1	SINGLE	2	-	BOX DRIVE UP ATM #1 FIXTURE (GEWH4848B4T)	-	-	-	OUT OF SCOPE	

CONTRACTOR RESPONSIBILITY NOTES:

- CONTRACTOR SHALL BE RESPONSIBLE FOR PERMITTING, INCLUDING COORDINATION WITH THE LOCAL JURISDICTION AND ANY ASSOCIATED PERMIT FEES OR PROCESSING. CONTRACTOR SHALL NOTIFY CARL VON KNEIP OF PERMIT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PERMITTING DOCUMENTS THAT ARE NOT INCLUDED IN THE LIGHTING DESIGN PACKAGE. THESE INCLUDE, BUT ARE NOT LIMITED TO, STAMPED ELECTRICAL DRAWINGS, STAMPED POLE BASE DRAWINGS, AND PROFESSIONAL SURVEY.
- SHOULD STAMPED PHOTOGRAPHIC DRAWINGS BE REQUIRED, CONTRACTOR SHALL ENGAGE LOCAL ENGINEER OR LIGHTING DESIGNER TO PROVIDE STAMP ON GMR PHOTOGRAPHIC DESIGN DOCUMENTS.
- CONTRACTOR SHALL PROVIDE THE BANNING CENTER NOTIFICATION AT LEAST ONE WEEK IN ADVANCE OF VISITING SITES OR STARTING WORK.
- CONTRACTOR SHALL VERIFY VOLTAGE REQUIREMENTS FOR FIXTURES PRIOR TO PLACEMENT OF FIXTURE ORDERS.
- CONTRACTOR TO VERIFY LIGHTING CONTROLS PRIOR TO BEGINNING CONSTRUCTION. SEE LIGHTING CONTROL NOTES.
- CONTRACTOR SHALL RECEIVE FORMAL APPROVAL FROM GMR ON ANY FIXTURE MODIFICATIONS OR VARIATIONS FROM THE LUMINAIRE SCHEDULE.
- CONTRACTOR SHALL VERIFY EXISTING AND PROPOSED FIXTURE MOUNTING CONDITIONS IN FIELD. ANY SPECIAL MOUNTING HARDWARE NEEDED FOR PROPOSED FIXTURES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR SHALL SUPPLY ALL NEW LIGHT POLES. NEW LIGHT POLES SHALL MATCH EXISTING CONDITIONS ON SITE FOR POLE TYPE AND PAINT COLOR.
- CONTRACTOR SHALL ORDER ALL FIXTURES FROM BORDER STATES IN ACCORDANCE WITH BANK OF AMERICA NATIONAL ACCOUNT CONTRACT NATIONAL ACCOUNT NOTICES DEMANDS AT BORDER STATES (TEXAS OR NEW YORK STATE).
- CONTRACTOR SHALL PROVIDE ALL NECESSARY PATCHING OR REPAIRING FOR HOLES, REMOVED, OR REPLACED FIXTURES.
- CONTRACTOR SHALL REPAIR ANY DISTURBED AREAS BACK TO EXISTING CONDITION INCLUDING PAVED AREAS, LANDSCAPED AREAS, ETC.
- CONTRACTOR SHALL VERIFY AND DOCUMENT COMPLETED WORK DURING NIGHT HOURS. ALL FIXTURES MUST BE FUNCTIONAL DURING NIGHT HOURS PRIOR TO SCHEDULING A FINAL SURVEY WITH GMR.
- CONTRACTOR SHALL PROVIDE BEFORE AND AFTER NIGHT TIME PHOTOS OF THE SITE.
- CONTRACTOR SHALL UTILIZE THE "JOB LEAD" PROTECTIVE SITE SURVEY POINT TO DOCUMENT THE EXACT DETAILS OF EACH FIXTURE BEING REMOVED FOR REPAIR AND ENERGY SAVINGS CALCULATION PURPOSES.
- CONTRACTOR SHALL RECEIVE A PURCHASE ORDER FROM GMR PRIOR TO ANY REMAINING ITEMS TO BE COMPLETED.

CONTROLS & ADDITIONAL NOTES:

THE CONTRACTOR SHALL VERIFY THE CONTROLS FOR ALL EXTERIOR LIGHTING AND ATM/HAZARD INTERIOR LOBBIES ON THE SITE (EXCLUDING SIGNAGE) AND ADJUST ACCORDING TO THE FOLLOWING:

- IC3 CONTROL:**
CONTRACTOR SHALL VERIFY THAT EXTERIOR LIGHTING CIRCUITS ARE CONTROLLED BY THE CORRECT IC3 CIRCUIT. WHERE EXTERIOR LIGHTING IS INCLUDED ON CONTROL CIRCUITS FOR INTERIOR SYSTEMS, INTERIOR LIGHTING, OR EXTERIOR SIGNAGE, CONTRACTOR SHALL ADJUST EXTERIOR LIGHTING TO THE CORRECT CONTROL CIRCUIT AS REQUIRED.
- PHOTOCELL CONTROL:**
CONTRACTOR SHALL REPLACE EXISTING PHOTOCELLS WITH NEW AND INSTALL IN A LOCATION BEST SUITED TO PROVIDE APPROPRIATE LIGHT EXPOSURE SUCH THAT EXTERIOR LIGHTS ARE ON DURING DARKNESS.
- TIME CLOCK CONTROL:**
CONTRACTOR SHALL VERIFY LOCATION OF TIME CLOCK. IF TIME CLOCK IS IN ELECTRICAL ROOM ADJACENT WITH IC3 CONTROL, CONTRACTOR SHALL ADJUST CIRCUIT TO BE CONTROLLED BY IC3 EXTERIOR LIGHTING CONTROLS. IF TIME CLOCK IS IN A REMOTE LOCATION NOT IN CLOSE PROXIMITY TO THE IC3 CONTROL, CONTRACTOR SHALL VERIFY TIME CLOCK IS SET PROPERLY AND LEAVE CIRCUIT ON TIME CLOCK CONTROL.
- MANUAL CONTROL:**
CONTRACTOR SHALL VERIFY THAT NO EXTERIOR LIGHTING IS CONTROLLED MANUALLY. IF ANY EXTERIOR LIGHTING IS ON A MANUALLY CONTROLLED CIRCUIT, CONTRACTOR SHALL ADJUST TO BE CONTROLLED BY PHOTOCELL OR IC3, WHICHEVER IS MOST ECONOMICALLY ACCOMMODATED.

ADDITIONAL CONTRACTOR NOTES:

CONSTRUCTION COMPLETION VERIFICATION:

UPON COMPLETION OF THE WORK, THE CONTRACTOR SHALL PROVIDE VERIFICATION IN WRITING TO THE BANK OF AMERICA FIRM THAT ALL WORK IS COMPLETE ACCORDING TO THE CONSTRUCTION DOCUMENTS, AND THAT ALL EXTERIOR LIGHTING IS FUNCTIONING DURING NIGHTTIME HOURS. COMPLETION PHOTOS, TAKEN AT NIGHT, SHALL BE PROVIDED IN THE FOLLOWING FORMAT:

PROVIDE A SINGLE DOCUMENT CONTAINING THE FOLLOWING:

- SITE PHOTOS FROM ALL SIDES OF BUILDING
- MINIMUM OF 3 PHOTOS OF EACH COMPLIANCE AREA (ATMS), AFTER-HOUR DEPOSITORIES, ASSOCIATE ENTRY FROM DIFFERENT ANGLES
- MINIMUM OF 2 PHOTOS OF ALL NON-COMPLIANCE AREAS FROM DIFFERENT ANGLES

FIXTURE CLARIFICATION NOTES:

- OUT OF SCOPE: EXISTING FIXTURES TO REMAIN ON SITE WITHOUT MODIFICATION. NO ACTION REQUIRED UNLESS NOTED OTHERWISE.
- REMOVE AND PATCH: EXISTING FIXTURES TO BE FULLY REMOVED AND ANY PAINTING, PATCHING OR ELECTRICAL WORK NEEDED IS TO BE ASSESSED AND PERFORMED BY CONTRACTOR.
- REPLACE EXISTING FIXTURE: EXISTING FIXTURE TO BE FULLY REMOVED AND REPLACED IN THE SAME LOCATION WITH A NEW FIXTURE. CONTRACTOR TO VERIFY IF POLE AND/OR POLE BASE IS SUFFICIENT FOR THE NEW FIXTURES. ANY PAINTING, PATCHING OR ELECTRICAL WORK NEEDED IS TO BE ASSESSED AND PERFORMED BY CONTRACTOR.
- ADD NEW FIXTURE: NEW FIXTURES TO BE ADDED. ANY PAINTING, PATCHING OR ELECTRICAL WORK NEEDED TO BE ASSESSED AND PERFORMED BY CONTRACTOR.
- ADD NEW POLE & FIXTURE: A NEW POLE AND FIXTURE TO BE ADDED. CONTRACTOR TO SPECIFY POLE TO MATCH EXISTING POLE TYPE AND COLOR AND, IF NOT PROVIDED, POLE BASE DATA FOR NEW POLE LOCATIONS. CONTRACTOR TO VERIFY IF POLE AND POLE BASE IS SUFFICIENT FOR THE HEIGHT, LOCATION AND FIXTURE SPECIFIED.
- GMR DOES NOT SPECIFY MOUNTING HARDWARE FOR ANY SPECIFIED FIXTURES. CONTRACTOR IS TO WORK WITH DISTRIBUTOR AND/OR MANUFACTURER ON A CASE BY CASE BASIS TO IDENTIFY AND ORDER REQUIRED MOUNTING HARDWARE.
- CONTRACTOR TO VERIFY WHETHER EXISTING WIRING LOCATIONS OR THE ADDITION OF WIRING FOR NEW FIXTURE LOCATIONS IS SUFFICIENT FOR THE DESIGNATED FIXTURE LOCATION.
- CONTRACTOR TO SPECIFY POLE COLOR AND TYPE PRIOR TO ORDERING.
- CONTRACTOR TO CONFIRM PRIOR TO ORDERING.

GENERAL NOTES:

- EXISTING CONDITIONS SHOWN ON THE DRAWINGS ARE BASED ON A LIMITED AMOUNT OF INFORMATION AVAILABLE TO THE ENGINEER. ALL SUCH CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO SUBMITTING THE BID AND ADJUSTED IF NECESSARY. NO ADDITIONAL COMPENSATION SHALL BE AWARDED AFTER AWARDING A BID FOR ANY EQUIPMENT, MATERIAL OR LABOR REQUIRED TO REWORK OR OTHERWISE MODIFY EXISTING CONDITIONS.
- THIS LIGHTING DESIGN IS BASED ON THE BANK'S CURRENT SECURITY STANDARDS. THE BANK'S CURRENT SECURITY POLICY FOR EXTERIOR ATM AND AFTER-HOUR DEPOSITORIES AND BANK GUIDELINES FOR NON-SECURITY COMPLIANCE ZONES.
- TRIM ALL TREES AND LANDSCAPING FROM AROUND THE PERIMETER OF THE BUILDING AND THE 6' RADIUS AROUND ALL ATMS AND A RADIUS OF 5' AROUND ALL AFTER-HOUR DEPOSITORIES. CONSIDERATION MUST BE GIVEN TO TREES AND LANDSCAPING AND STATE OF FULL FOLIAGE AND FUTURE GROWTH. ALL LANDSCAPING WORK WILL BE PERFORMED BY OTHERS WITH A SEPARATE PERMIT (IF REQUIRED).
- ALL MOUNTING HEIGHTS ARE INTENDED TO THE BOTTOM OF THE FIXTURE.
- CONTRACTOR TO FIELD VERIFY FIXTURE PLACEMENT DIMENSIONS PRIOR TO CONSTRUCTION.
- DARKENING PROVIDED IS FOR PROPOSED FIXTURE LOCATIONS ONLY, UNLESS OTHERWISE NOTED ON THE DRAWING. THE CONTRACTOR SHALL ATTEMPT TO ELIMINATE THE USE OF EXPOSED CONDUIT WHERE POSSIBLE. IF EXPOSED CONDUIT IS NECESSARY, THE CONTRACTOR SHALL VERIFY USE WITH PROJECT MANAGER.
- ALL EXISTING LIGHTS SHALL BE REPLACED WITH LED LIGHTS AND ALL PROPOSED LIGHTS WILL ALSO BE LED, UNLESS OTHERWISE NOTED.
- ALL FIXTURES ARE TO BE MOUNTED ABOVE FINISH GRADE.
- UNLESS OTHERWISE NOTED, MATCH EXISTING POLE BASES.

SITE ABBREVIATIONS:

- PL = PROPERTY LINE
- AFG = ABOVE FINISHED GRADE
- FC = FOOT CANDLE
- CBO = CONTROLLED BY OTHERS
- AHD = AFTER HOUR DEPOSITORY


NOTE: THIS LIGHTING PLAN ILLUSTRATES ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA UNDER CONTROLLED CONDITIONS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY OF NORTH AMERICA (IESNA) APPROVED METHODS. ACTUAL SITE ILLUMINATION LEVELS AND PERFORMANCE OF LUMINAIRES MAY VARY DUE TO VARIATIONS IN WEATHER, ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER RELATED VARIABLE FIELD CONDITIONS.

SITE NOTES:


-


EXISTING CONDITIONS:

- EXISTING POLES - DECORATIVE - STEEL
- EXISTING POLE BASES - 5"
- EXISTING DRIVE THRU CEILING - N/A

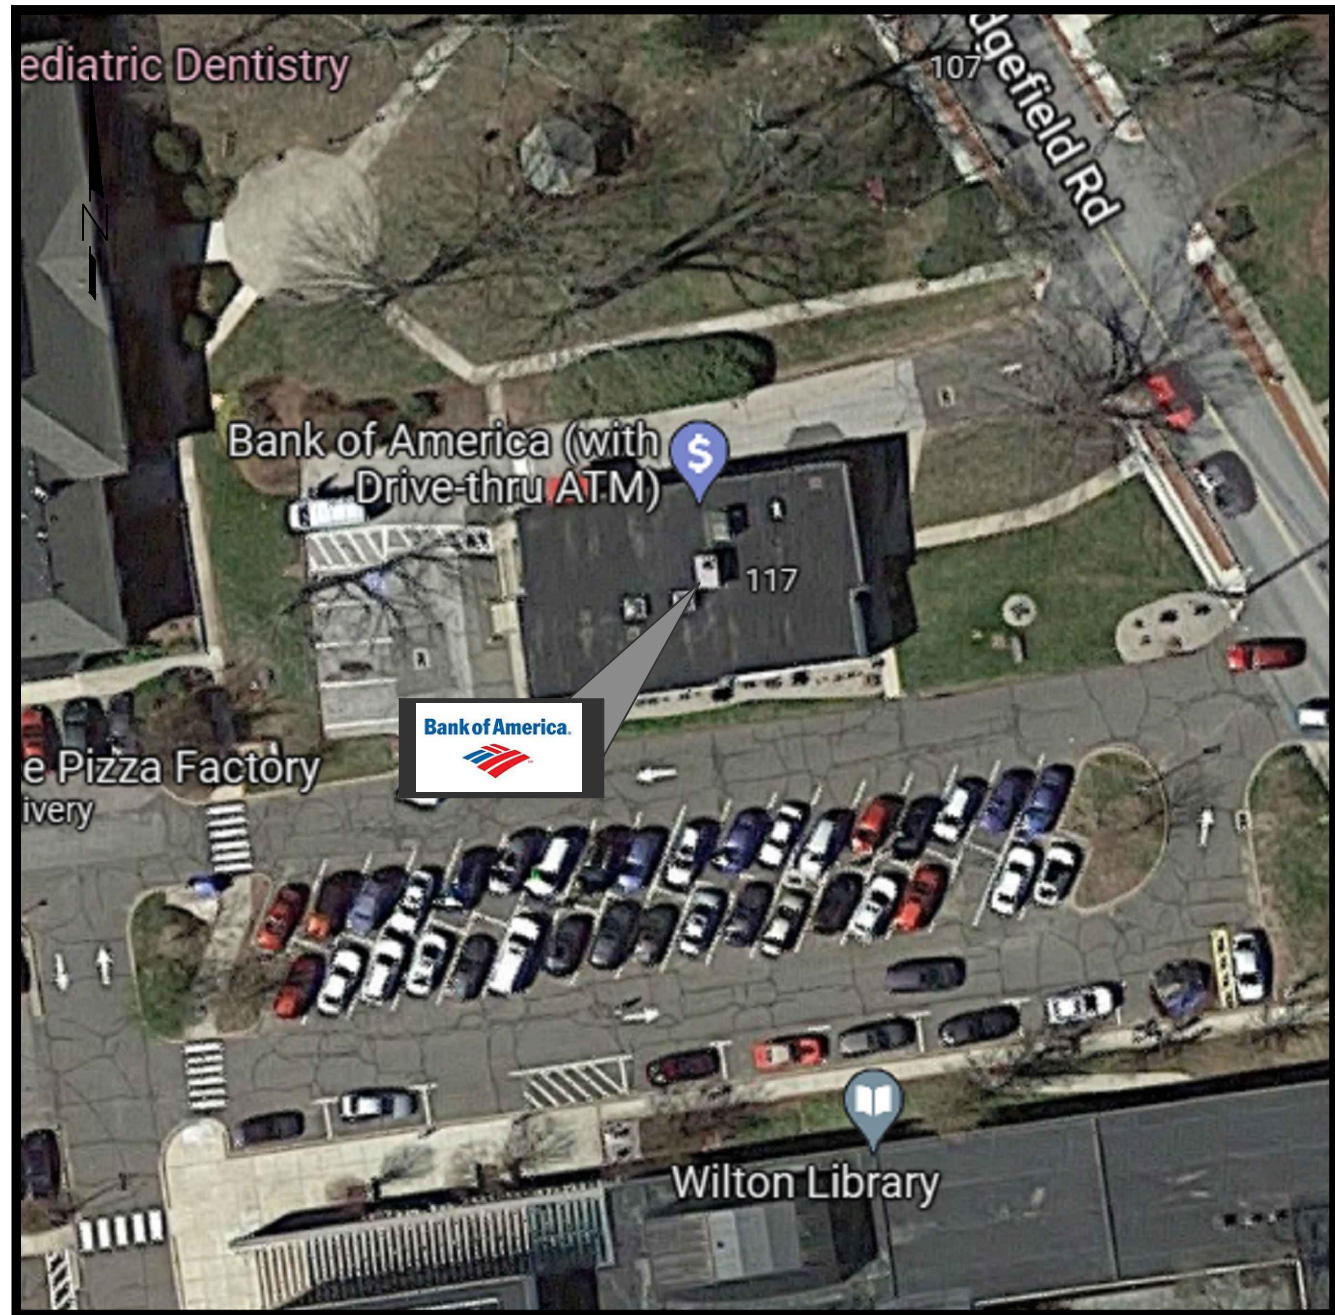

VICINITY MAP

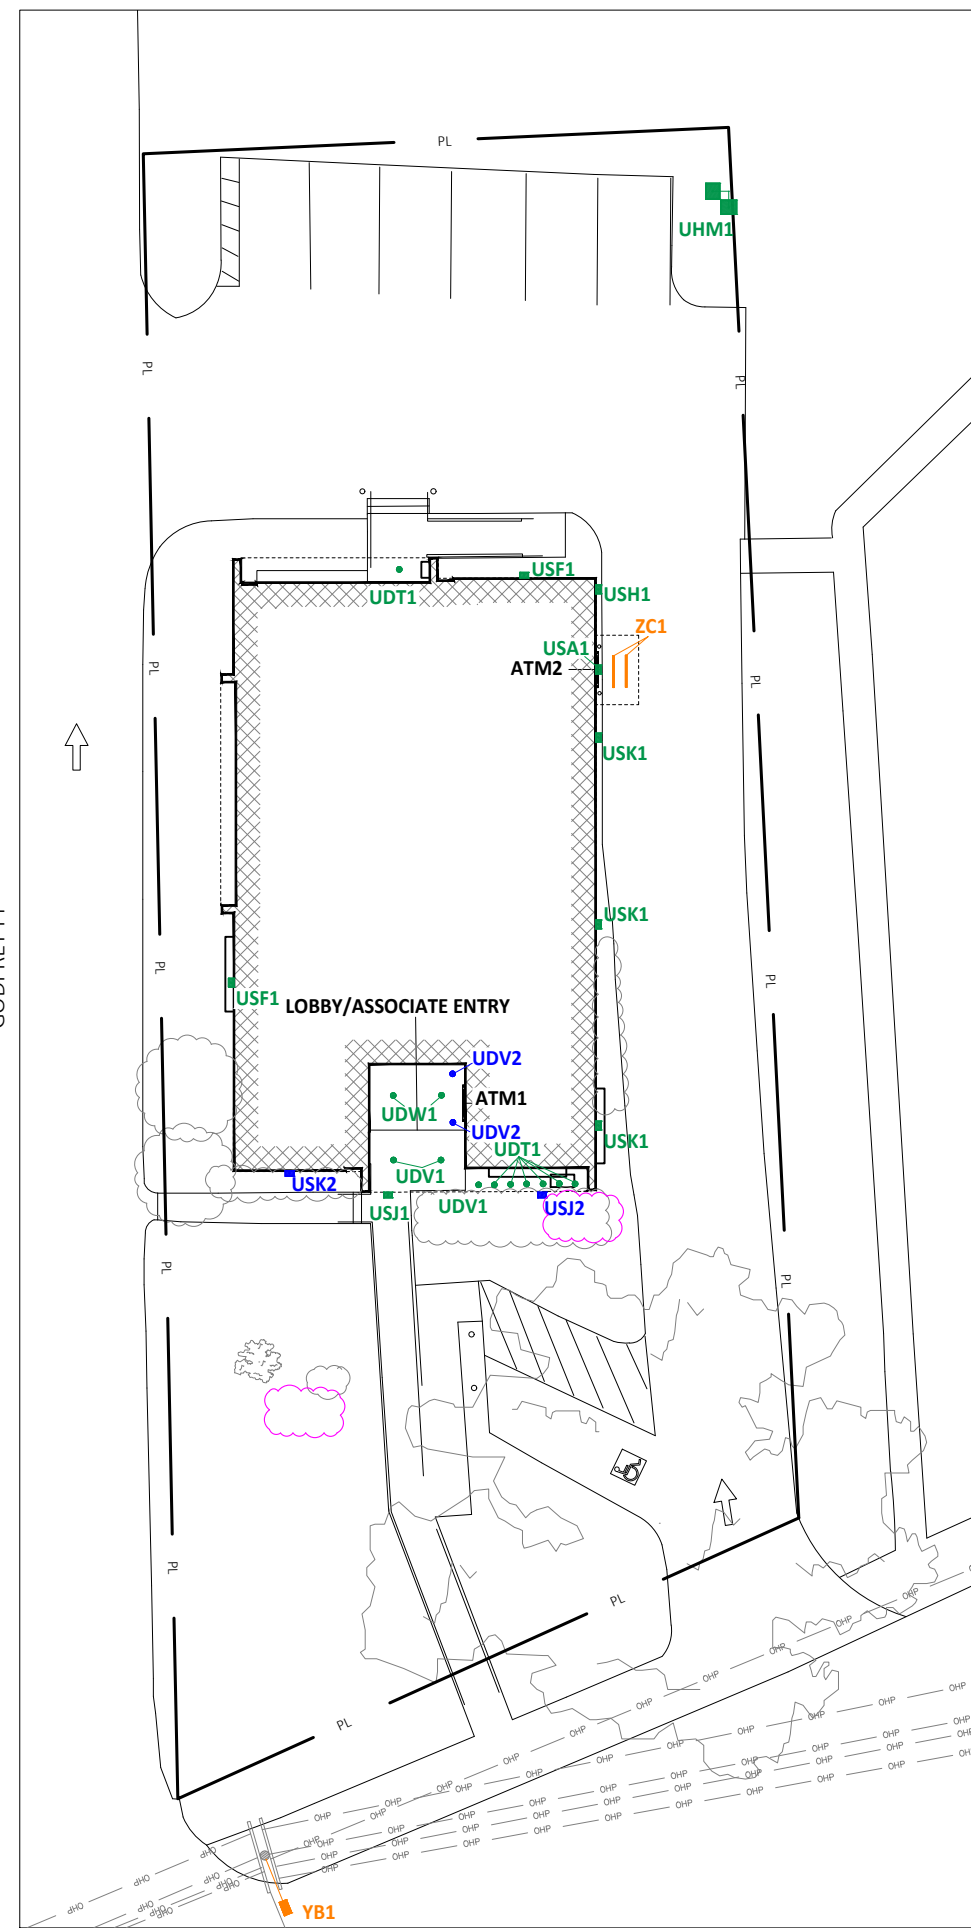

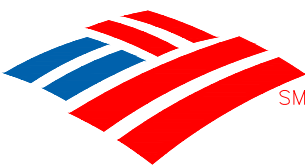

BLUE = NEW FIXTURE
GREEN = EXISTING FIXTURE LOCATION TO BE REPLACED
ORANGE = EXISTING FIXTURE TO REMAIN
TURQUOISE = FIXTURE TO BE REMOVED
PINK = REPLACE WITH NEW POLE AT NEW HEIGHT
— = INDICATES NEW SECURITY FENCE
— PL — = PROPERTY LINE BASED ON COUNTY APPRAISAL INFORMATION



N.T.S.

v4 220623

		KRM
REVISION NO.	DESCRIPTION	REVISED BY




Wilton
CT2-255
117 Old Ridgefield Rd
Wilton, CT

SITE DETAILS

DESIGN BY:	JDH	DRAWN BY:	RCS
REVIEWED BY:	AJH	APPROVED BY:	KRM


SHEET NO.	LU-1
-----------	------

COMPLIANCE AREA

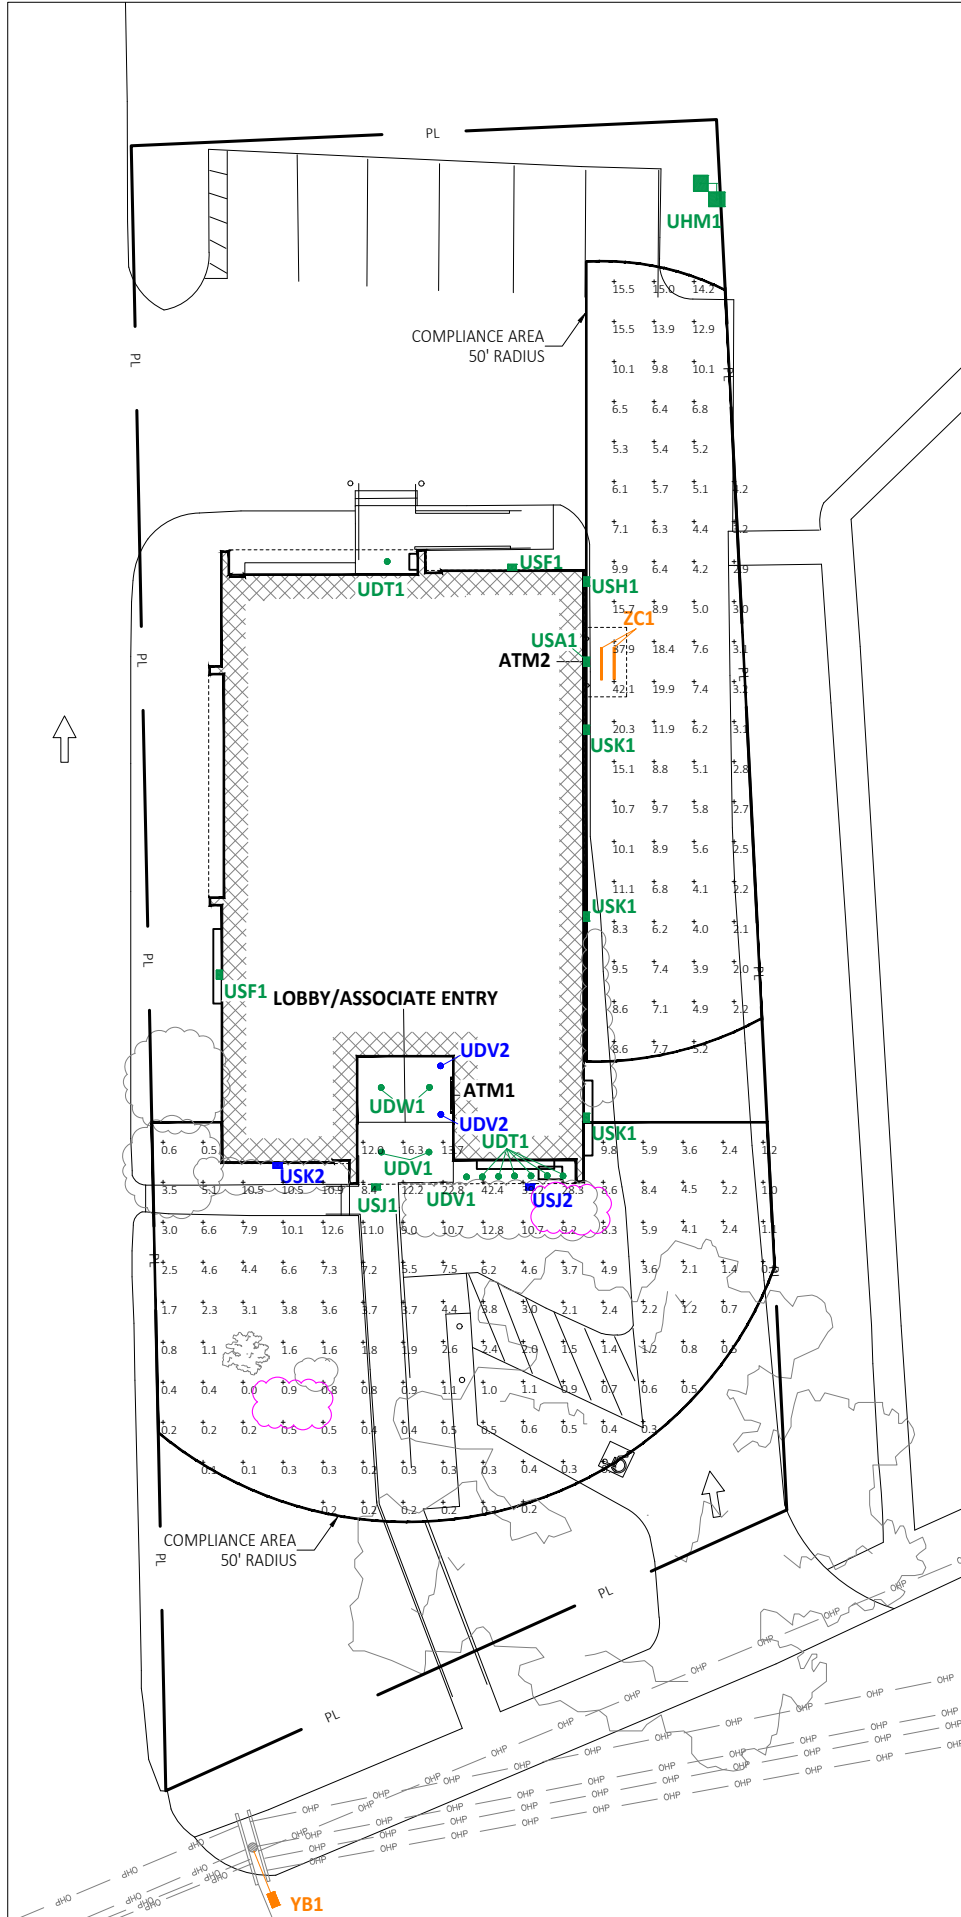


SCALE: 1/2" = 1'-0"

FULL SITE CALCS

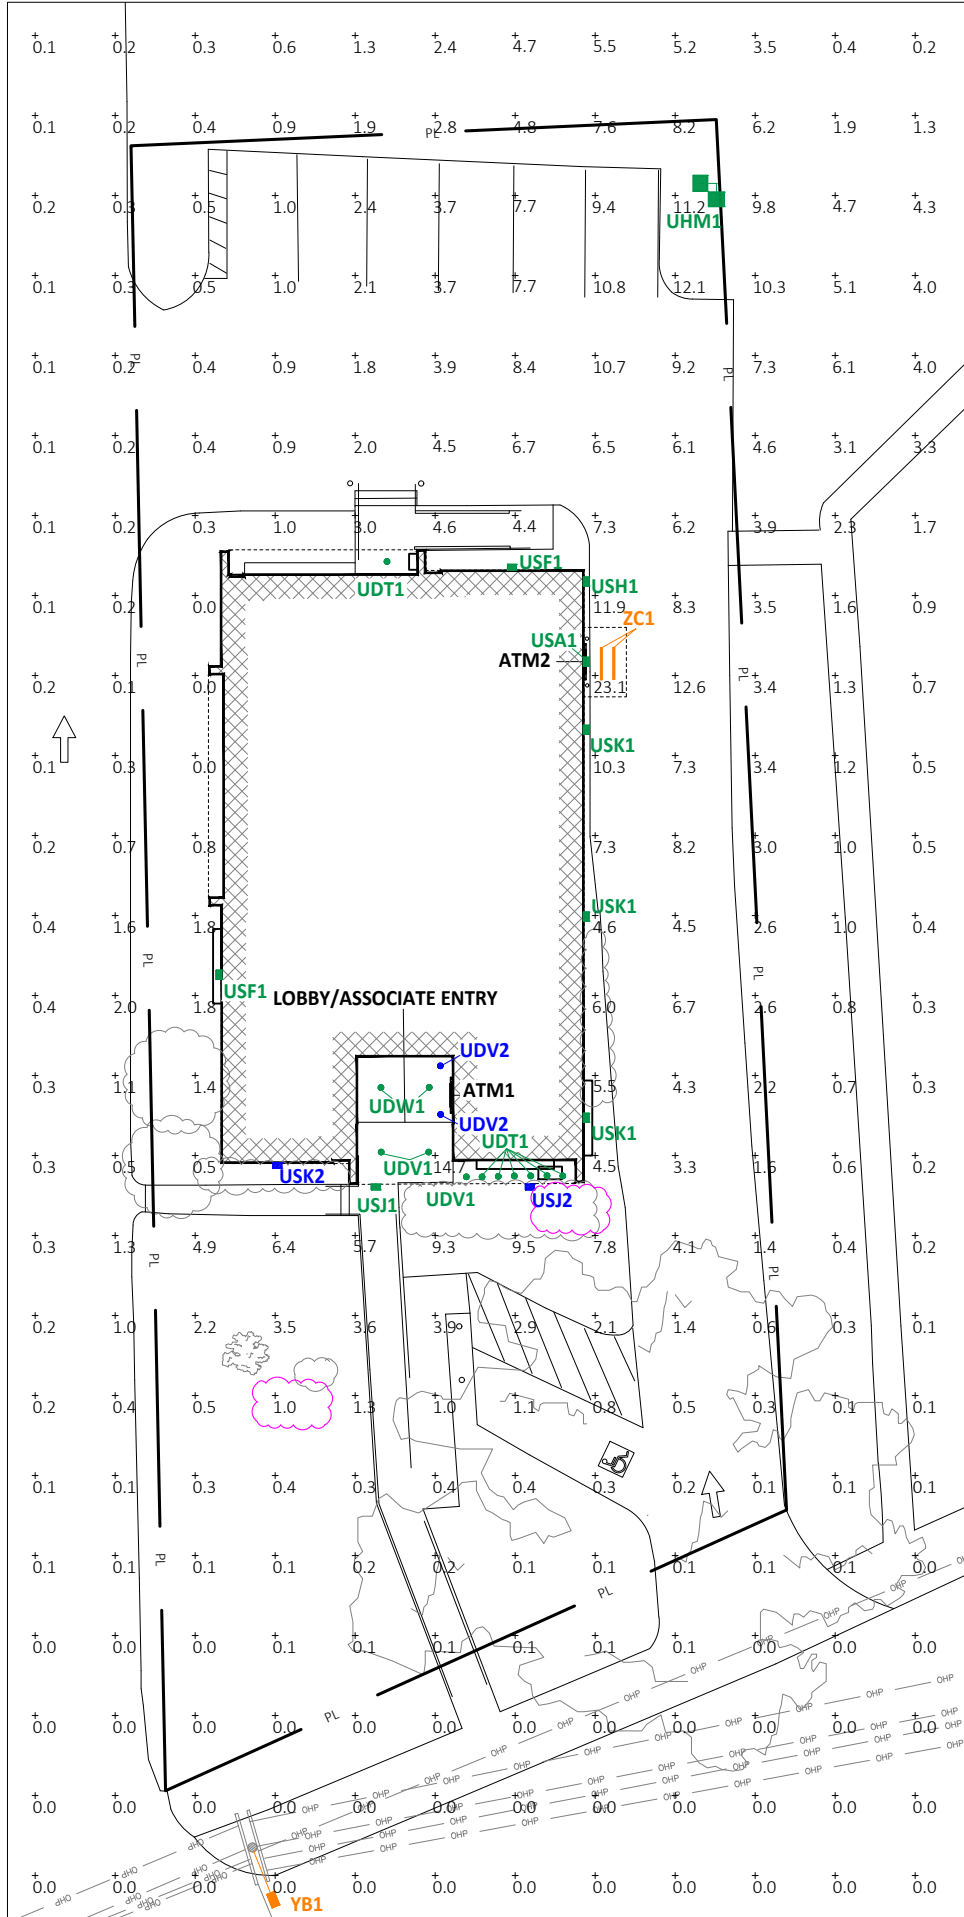


SCALE: 1/2" = 1'-0"

LANDSCAPE

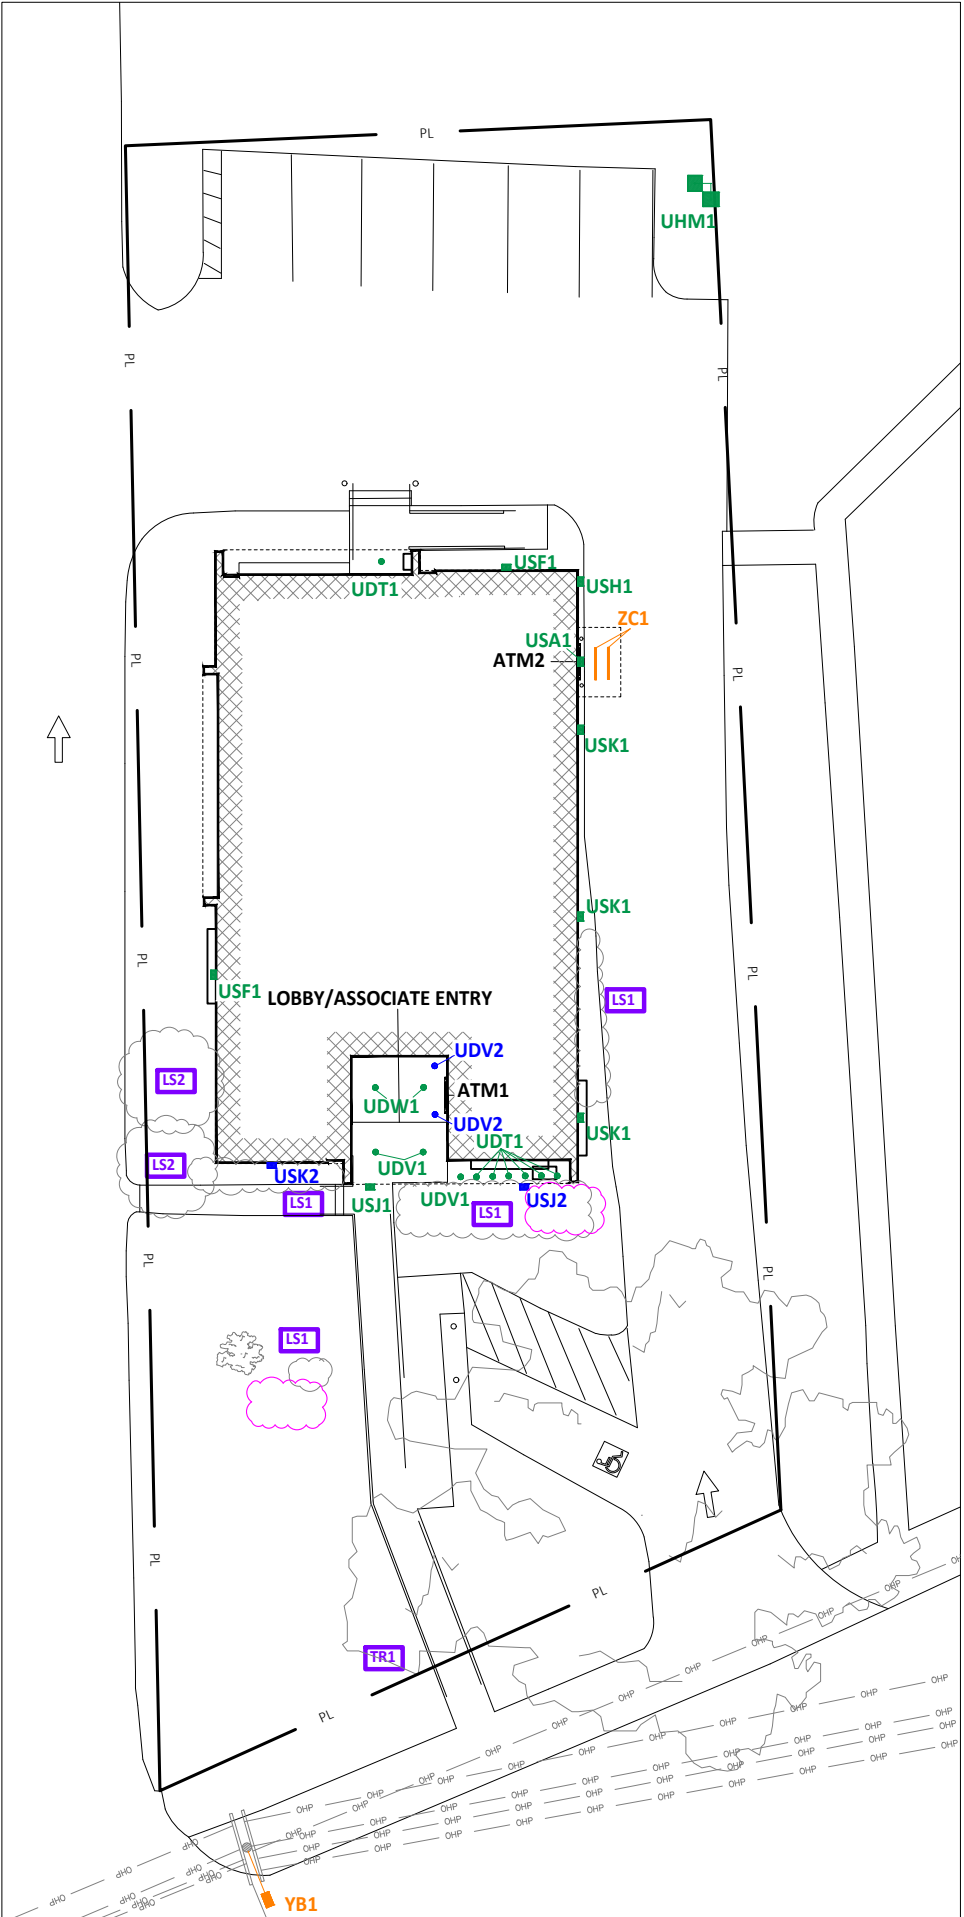

SCALE: 1/2" = 1'-0"

DIMENSIONS

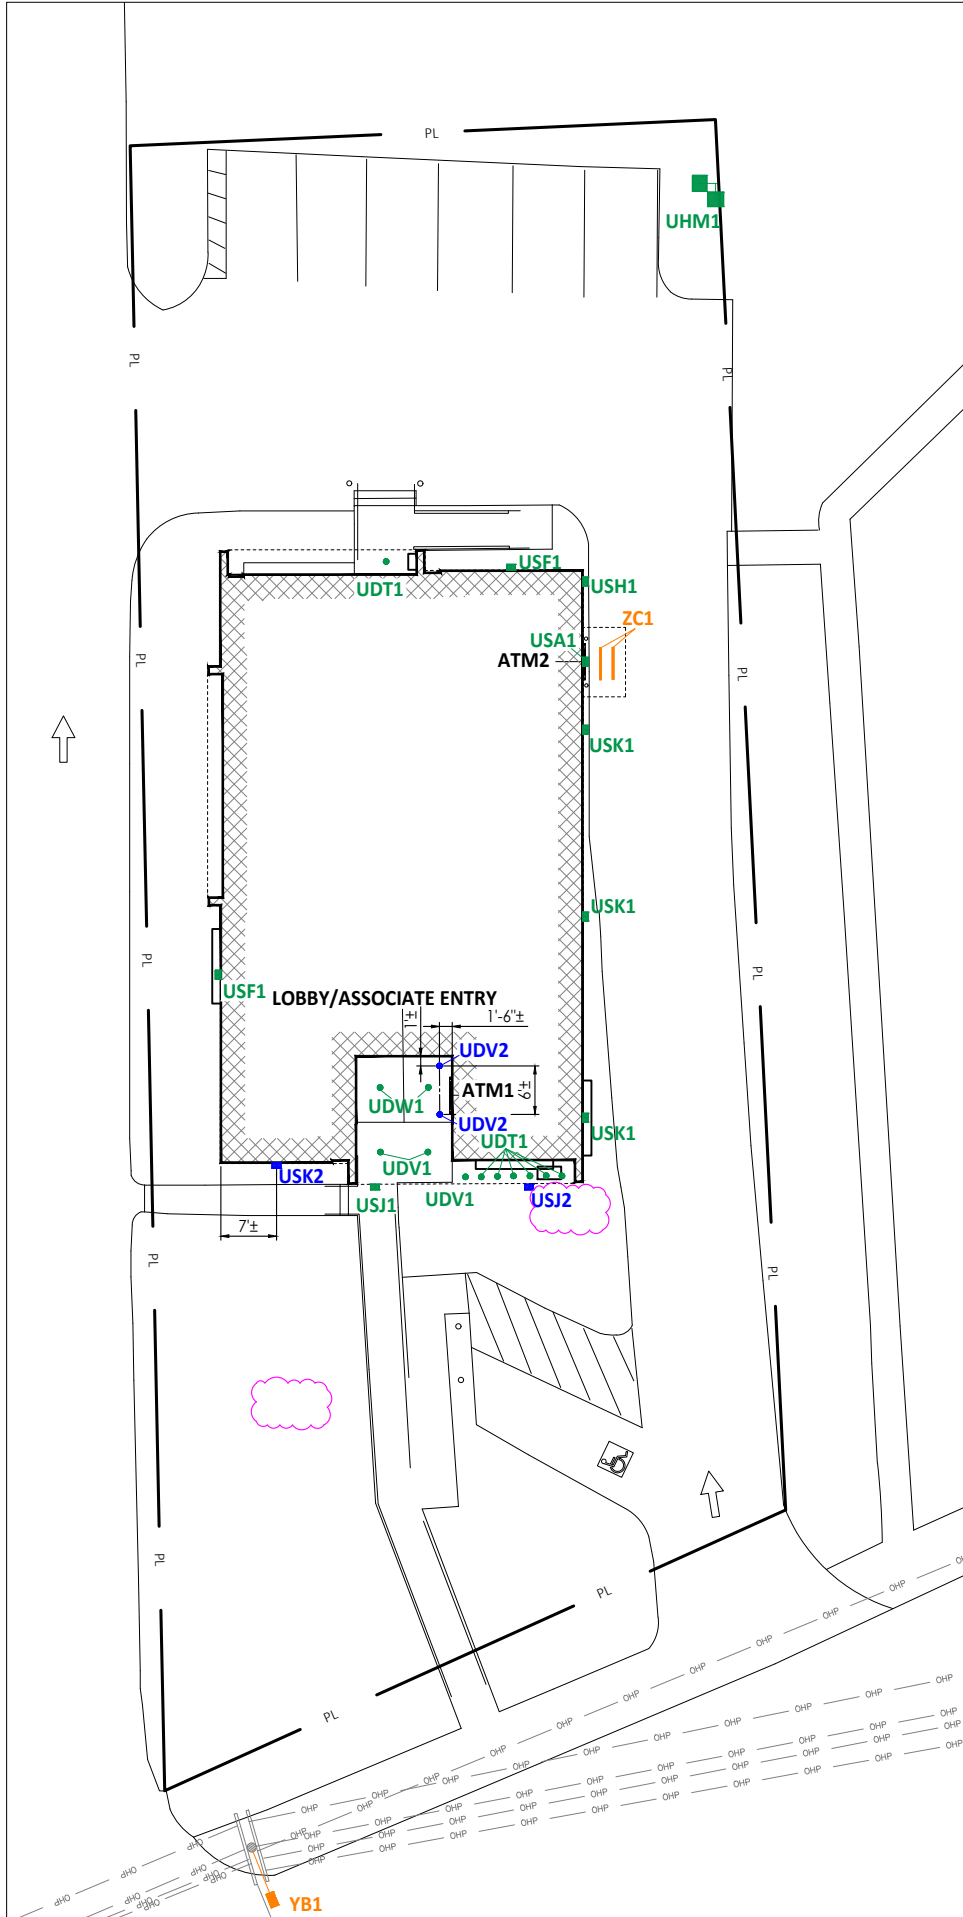

SCALE: 1/2" = 1'-0"

QTY	LABEL	NOTES	MOUNTING HEIGHT
7	UDT1	REPLACE EXISTING FIXTURE	MATCH EXISTING
3	UDV1	REPLACE EXISTING FIXTURE	MATCH EXISTING
2	UDV2	ADD NEW FIXTURE - MATCH EXISTING CANOPY HEIGHT	8' AFG
2	UDV1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	UHM1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USA1	REPLACE EXISTING FIXTURE	MATCH EXISTING
2	USF1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USH1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USI1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USI2	ADD NEW FIXTURE	11' - 6" AFG
3	USK1	REPLACE EXISTING FIXTURE	MATCH EXISTING
1	USK2	ADD NEW FIXTURE	11' AFG
1	YB1	OUT OF SCOPE	-
2	ZC1	OUT OF SCOPE	-

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
UDT1 50' @ 36"	Illuminance	Fc	8.53	42.1	2.0	4.27	21.05
UDV1 50' @ 36"	Illuminance	Fc	4.31	42.4	0.0	N.A.	N.A.

NOTES:
1. READINGS ARE MEASURED AT 36" (3') ABOVE GRADE.

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
FULL SITE @ GRADE	Illuminance	Fc	2.25	23.1	0.0	N.A.	N.A.

NOTES:
1. THE SCOPE OF WORK FOR THIS PROJECT IS LIMITED TO EXTERIOR LIGHTING RENOVATIONS AS SHOWN ON THE PLANS.
2. REFERENCE THE LUMINAIRE SCHEDULE FOR ADDITIONAL LIGHT FIXTURE INFORMATION.

SITE NOTES:
1. EXISTING POLES - DECORATIVE - STEEL 2. EXISTING POLE BASES - 12" 3. EXISTING DRIVE THRU CEILING - N/A
EXISTING CONDITIONS:
1. EXISTING POLES - DECORATIVE - STEEL 2. EXISTING POLE BASES - 12" 3. EXISTING DRIVE THRU CEILING - N/A

SYMBOL	QTY	NOTES
TR1	1	TRIM TREE UP TO 15' AND AWAY FROM LIGHT FIXTURE TO ENSURE THAT IT DOES NOT INTERFERE WITH INTERFERED ILLUMINATION
LS1	-	TRIM LANDSCAPING DOWN TO 30"
LS2	2	REMOVE LANDSCAPING AND REPLACE WITH LANDSCAPING THAT CAN BE MAINTAINED AT 30"

NOTE: THIS LIGHTING PLAN ILLUSTRATES ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA UNDER CONTROLLED CONDITIONS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY OF NORTH AMERICA (IESNA) APPROVED METHODS. ACTUAL SITE ILLUMINATION LEVELS AND PERFORMANCE OF LUMINAIRES MAY VARY DUE TO VARIATIONS IN WEATHER, ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER RELATED VARIABLE FIELD CONDITIONS.

Cree Edge™ Series

LED Security Wall Pack Luminaire

Product Description

The Cree Edge™ wall mount luminaire has a slim, low profile design. The luminaire end caps are made from rugged die cast aluminum with integral, weathertight LED driver compartments and high performance aluminum heat sinks specifically designed for LED applications. Housing is rugged aluminum. Includes a lightweight mounting box for installation over standard and mud ring single gang J-Boxes. Secures to wall with four 3/16" (5mm) screws (by others). Conduit entry from top, bottom, sides and rear. Allows mounting for uplight or downlight. Designed and approved for easy through-wiring. Includes leaf/debris guard.

Applications: General area and security lighting

Performance Summary

Patented NanoOptic® Product Technology

Assembled in the U.S.A. of U.S. and imported parts

CRI: Minimum 70 CRI

CCT: 4000K (+/- 300K), 5700K (+/- 500K) standard


Limited Warranty*: 10 years on luminaire/10 years on Colorfast DeltaGuard® finish

* See <http://lighting.cree.com/warranty> for warranty terms

Accessories

Field-Installed		
Bird Spikes XA-BRDSPK	Beauty Plate WM-PLT12** - 12" (305mm) Square WM-PLT14** - 14" (356mm) Square - Covers holes left by incumbent wall packs	Hand-Held Remote XA-SENSREM - For successful implementation of the programmable multi-level option, a minimum of one hand-held remote is required

** Must specify color

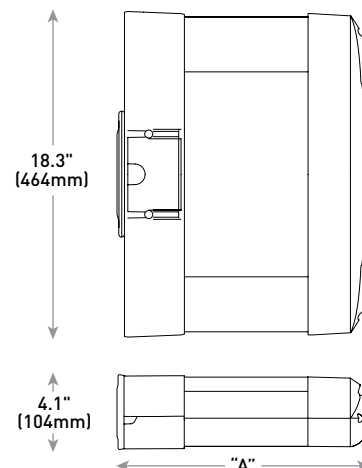

LED Count (x10)	Dim. "A"	Weight
02	9.9" (251mm)	20 lbs. (9.1kg)
04	11.9" (303mm)	22 lbs. (10.0kg)
06	13.9" (353mm)	25 lbs. (11.3kg)
08	15.9" (404mm)	27 lbs. (12.2kg)
10	17.9" (455mm)	31 lbs. (14.1kg)
12	19.9" (505mm)	32 lbs. (14.5kg)

Ordering Information

Example: SEC-EDG-2M-WM-06-E-UL-SV-700

SEC-EDG		WM		E				
Product	Optic	Mounting	LED Count (x10)	Series	Voltage	Color Options	Drive Current	Options
SEC-EDG	2M Type II Medium 2MB Type II Medium w/BLS 2S Type II Short 2SB Type II Short w/BLS 3M Type III Medium 3MB Type III Medium w/BLS 4M Type IV Medium 4MB Type IV Medium w/BLS	WM Wall Mount	02 04 06 08 10 12	E	UL Universal 120-277V UH Universal 347-480V 34 347V	BK Black BZ Bronze SV Silver WH White	350 350mA 525 525mA -Available with 20-80 LEDs 700 700mA -Available with 20-60 LEDs	DIM 0-10V Dimming - Control by others - Refer to Dimming spec sheet for details - Can't exceed specified drive current F Fuse - Refer to PML spec sheet for availability with PML options - Available for U.S. applications only - When code dictates fusing, use time delay fuse ML Multi-Level - Refer to ML spec sheet for details - Intended for downlight applications with 0° tilt - Available only with 20 LEDs and UL voltage - May only be combined with F option with 525mA drive current - Not available with other options P Photocell - Must specify UL or 34 voltage PML Programmable Multi-Level - Refer to PML spec sheet for details - Intended for downlight applications with 0° tilt 40K 4000K Color Temperature - Minimum 70 CRI - Color temperature per luminaire



US: lighting.cree.com

T (800) 236-6800 F (262) 504-5415

Rev. Date: V5 01/09/2019

Canada: www.cree.com/canada



T (800) 473-1234 F (800) 890-7507

Product Specifications

CONSTRUCTION & MATERIALS

- Slim, low profile design
- Luminaire sides are rugged die cast aluminum with integral, weathertight LED driver compartment and high performance aluminum heat sinks specifically designed for LED applications
- Housing is rugged aluminum
- Furnished with low copper, light weight mounting box designed for installation over standard and mud ring single gang J-Boxes
- Luminaire can also be direct mounted to a wall and surface wired
- Secures to wall with four 3/16" (5mm) screws (by others)
- Conduit entry from top, bottom, sides, and rear
- Allows mounting for uplight or downlight
- Designed and approved for easy through-wiring
- Includes leaf/debris guard
- Exclusive Colorfast DeltaGuard® finish features an E-Coat epoxy primer with an ultradurable powder topcoat, providing excellent resistance to corrosion, ultraviolet degradation and abrasion. Black, bronze, silver and white are available
- **Weight:** See Dimensions and Weight Chart on page 1

ELECTRICAL SYSTEM

- **Input Voltage:** 120–277V or 347–480V, 50/60Hz, Class 1 drivers
- **Power Factor:** > 0.9 at full load
- **Total Harmonic Distortion:** < 20% at full load
- Integral weathertight J-Box with leads (wire nuts) for easy power hook up
- Integral 10kV surge suppression protection standard
- When code dictates fusing, a slow blow fuse or type C/D breaker should be used to address inrush current
- **Maximum 10V Source Current:** 20 LED (350mA): 10mA; 20LED (525 & 700 mA) and 40-120 LED: 0.15mA

REGULATORY & VOLUNTARY QUALIFICATIONS

- cULus Listed
- Suitable for wet locations
- Meets FCC Part 15, Subpart B, Class A standards for conducted and radiated emissions
- Enclosure rated IP66 per IEC 60529 when ordered without P, PML or ML options
- 10kV surge suppression protection tested in accordance with IEEE/ANSI C62.41.2
- Luminaire and finish endurance tested to withstand 5,000 hours of elevated ambient salt fog conditions as defined in ASTM Standard B 117
- DLC qualified with select SKUs. Refer to <https://www.designlights.org/search/> for most current information
- Meets Buy American requirements within ARRA

Electrical Data*							
LED Count (x10)	System Watts 120-480V	Total Current (A)					
		120V	208V	240V	277V	347V	480V
350mA							
02	25	0.21	0.13	0.11	0.10	0.08	0.07
04	46	0.36	0.23	0.21	0.20	0.15	0.12
06	66	0.52	0.31	0.28	0.26	0.20	0.15
08	90	0.75	0.44	0.38	0.34	0.26	0.20
10	110	0.92	0.53	0.47	0.41	0.32	0.24
12	130	1.10	0.63	0.55	0.48	0.38	0.28
525mA							
02	37	0.30	0.19	0.17	0.16	0.12	0.10
04	70	0.58	0.34	0.31	0.28	0.21	0.16
06	101	0.84	0.49	0.43	0.38	0.30	0.22
08	133	1.13	0.66	0.58	0.51	0.39	0.28
700mA							
02	50	0.41	0.25	0.22	0.20	0.15	0.12
04	93	0.78	0.46	0.40	0.36	0.27	0.20
06	134	1.14	0.65	0.57	0.50	0.39	0.29

* Electrical data at 25°C (77°F). Actual wattage may differ by +/- 10% when operating between 120-480V +/- 10%

Cree Edge™ Series Ambient Adjusted Lumen Maintenance¹					
Ambient	Initial LMF	25K hr Projected² LMF	50K hr Projected² LMF	75K hr Calculated³ LMF	100K hr Calculated³ LMF
5°C (41°F)	1.04	1.01	0.99	0.98	0.96
10°C (50°F)	1.03	1.00	0.98	0.97	0.95
15°C (59°F)	1.02	0.99	0.97	0.96	0.94
20°C (68°F)	1.01	0.98	0.96	0.95	0.93
25°C (77°F)	1.00	0.97	0.95	0.94	0.92

¹ Lumen maintenance values at 25°C (77°F) are calculated per TM-21 based on LM-80 data and in-situ luminaire testing. Luminaire ambient temperature factors (LATF) have been applied to all lumen maintenance factors. Please refer to the [Temperature Zone Reference Document](#) for outdoor average nighttime ambient conditions.

² In accordance with IESNA TM-21-11, Projected Values represent interpolated value based on time durations that are within six times (6X) the IESNA LM-80-08 total test duration (in hours) for the device under testing (IDUT) i.e. the packaged LED chip


³ In accordance with IESNA TM-21-11, Calculated Values represent time durations that exceed six times (6X) the IESNA LM-80-08 total test duration (in hours) for the device under testing (IDUT) i.e. the packaged LED chip




Photometry

All published luminaire photometric testing performed to IESNA LM-79-08 standards by a NVLAP accredited laboratory. To obtain an IES file specific to your project consult: <http://lighting.cree.com/products/outdoor/wall-mount/cree-edge-series-5>

2M



RESTL Test Report #: PL10270-004B
ARE-EDG-2M-**-06-E-UL-525-40K
Initial Delivered Lumens: 10,053



SEC-EDG-2M-**-06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 12,425
Initial FC at grade


Type II Medium Distribution

LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	2,501	B1 U0 G1	2,551	B1 U0 G1
04	5,003	B1 U0 G1	5,102	B1 U0 G1
06	7,418	B2 U0 G2	7,565	B2 U0 G2
08	9,891	B2 U0 G2	10,087	B2 U0 G2
10	12,334	B2 U0 G2	12,578	B2 U0 G2
12	14,801	B3 U0 G3	15,094	B3 U0 G3
525mA				
02	3,550	B1 U0 G1	3,624	B1 U0 G1
04	7,099	B2 U0 G2	7,248	B2 U0 G2
06	10,527	B2 U0 G2	10,748	B2 U0 G2
08	14,037	B3 U0 G3	14,331	B3 U0 G3
700mA				
02	4,189	B1 U0 G1	4,275	B1 U0 G1
04	8,379	B2 U0 G2	8,549	B2 U0 G2
06	12,425	B2 U0 G2	12,678	B2 U0 G2


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>

2MB



RESTL Test Report #: PL10023-003B
ARE-EDG-2MB-**-06-E-UL-525-40K
Initial Delivered Lumens: 7,784



SEC-EDG-2MB-**-06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 9,359
Initial FC at grade

Type II Medium Distribution w/BLS

LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	1,884	B0 U0 G1	1,921	B0 U0 G1
04	3,768	B1 U0 G1	3,843	B1 U0 G1
06	5,588	B1 U0 G1	5,698	B1 U0 G1
08	7,450	B1 U0 G2	7,598	B1 U0 G2
10	9,291	B1 U0 G2	9,475	B1 U0 G2
12	11,149	B1 U0 G2	11,370	B1 U0 G2
525mA				
02	2,674	B0 U0 G1	2,730	B0 U0 G1
04	5,348	B1 U0 G1	5,460	B1 U0 G1
06	7,930	B1 U0 G2	8,096	B1 U0 G2
08	10,573	B1 U0 G2	10,794	B1 U0 G2
700mA				
02	3,156	B0 U0 G1	3,220	B0 U0 G1
04	6,311	B1 U0 G1	6,440	B1 U0 G1
06	9,359	B1 U0 G2	9,549	B1 U0 G2

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens


** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>




Photometry

All published luminaire photometric testing performed to IESNA LM-79-08 standards by a NVLAP accredited laboratory. To obtain an IES file specific to your project consult: <http://lighting.cree.com/products/outdoor/wall-mount/cree-edge-series-5>

25



ITL Test Report #: 79175
SEC-EDG-2S**-06-E-UL-700-40K
Initial Delivered Lumens: 11,704




SEC-EDG-2S**-06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 13,232
Initial FC at grade

Type II Short Distribution				
LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	2,664	B1 U0 G1	2,716	B1 U0 G1
04	5,327	B2 U0 G2	5,433	B2 U0 G2
06	7,900	B2 U0 G2	8,056	B2 U0 G2
08	10,533	B3 U0 G3	10,742	B3 U0 G3
10	13,135	B3 U0 G3	13,395	B3 U0 G3
12	15,762	B3 U0 G3	16,074	B3 U0 G3
525mA				
02	3,780	B1 U0 G1	3,859	B1 U0 G1
04	7,560	B2 U0 G2	7,719	B2 U0 G2
06	11,211	B3 U0 G3	11,446	B3 U0 G3
08	14,948	B3 U0 G3	15,261	B3 U0 G3
700mA				
02	4,461	B1 U0 G1	4,552	B1 U0 G1
04	8,923	B2 U0 G2	9,104	B2 U0 G2
06	13,232	B3 U0 G3	13,501	B3 U0 G3


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>

25B



CSA Test Report #: 6454
ARE-EDG-2SB**-06-E-UL-700-40K
Initial Delivered Lumens: 9,202



SEC-EDG-2SB**-06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 10,166
Initial FC at grade

Type II Short Distribution w/BLS				
LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	2,046	B0 U0 G1	2,087	B0 U0 G1
04	4,093	B1 U0 G1	4,174	B1 U0 G1
06	6,069	B1 U0 G1	6,190	B1 U0 G1
08	8,093	B1 U0 G1	8,253	B1 U0 G1
10	10,091	B2 U0 G2	10,291	B2 U0 G2
12	12,110	B2 U0 G2	12,350	B2 U0 G2
525mA				
02	2,904	B1 U0 G1	2,965	B1 U0 G1
04	5,809	B1 U0 G1	5,930	B1 U0 G1
06	8,613	B1 U0 G1	8,794	B1 U0 G1
08	11,484	B2 U0 G2	11,725	B2 U0 G2
700mA				
02	3,428	B1 U0 G1	3,497	B1 U0 G1
04	6,855	B1 U0 G1	6,995	B1 U0 G1
06	10,166	B2 U0 G2	10,373	B2 U0 G2


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>


Photometry

All published luminaire photometric testing performed to IESNA LM-79-08 standards by a NVLAP accredited laboratory. To obtain an IES file specific to your project consult: <http://lighting.cree.com/products/outdoor/wall-mount/cree-edge-series-5>

3M




RESTL Test Report #: PL09405-001A
ARE-EDG-3M-**-06-E-UL-525-40K
Initial Delivered Lumens: 9,460




SEC-EDG-3M-**-06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 11,779
Initial FC at grade

3MB



RESTL Test Report #: PL10023-001B
ARE-EDG-3MB-**-06-E-UL-525-40K
Initial Delivered Lumens: 7,602



SEC-EDG-3MB-**-06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 8,714
Initial FC at grade

Type III Medium Distribution				
LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	2,371	B1 U0 G1	2,418	B1 U0 G1
04	4,743	B1 U0 G1	4,837	B1 U0 G1
06	7,033	B2 U0 G2	7,172	B2 U0 G2
08	9,377	B2 U0 G2	9,563	B2 U0 G2
10	11,693	B3 U0 G3	11,925	B3 U0 G3
12	14,032	B3 U0 G3	14,310	B3 U0 G3
525mA				
02	3,365	B1 U0 G1	3,436	B1 U0 G1
04	6,731	B2 U0 G2	6,872	B2 U0 G2
06	9,981	B3 U0 G3	10,190	B3 U0 G3
08	13,307	B3 U0 G3	13,586	B3 U0 G3
700mA				
02	3,972	B1 U0 G1	4,053	B1 U0 G1
04	7,944	B2 U0 G2	8,105	B2 U0 G2
06	11,779	B3 U0 G3	12,019	B3 U0 G3

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>

Type III Medium Distribution w/BLS				
LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	1,754	B0 U0 G1	1,789	B0 U0 G1
04	3,508	B1 U0 G1	3,578	B1 U0 G1
06	5,202	B1 U0 G2	5,305	B1 U0 G2
08	6,936	B1 U0 G2	7,074	B1 U0 G2
10	8,650	B1 U0 G2	8,821	B1 U0 G2
12	10,380	B1 U0 G3	10,585	B1 U0 G3
525mA				
02	2,489	B0 U0 G1	2,542	B0 U0 G1
04	4,979	B1 U0 G2	5,083	B1 U0 G2
06	7,383	B1 U0 G2	7,538	B1 U0 G2
08	9,844	B1 U0 G2	10,050	B1 U0 G3
700mA				
02	2,938	B1 U0 G1	2,998	B1 U0 G1
04	5,876	B1 U0 G2	5,996	B1 U0 G2
06	8,714	B1 U0 G2	8,891	B1 U0 G2

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>




Cree Edge™ LED Security Wall Pack Luminaire


Photometry

All published luminaire photometric testing performed to IESNA LM-79-08 standards by a NVLAP accredited laboratory. To obtain an IES file specific to your project consult: <http://lighting.cree.com/products/outdoor/wall-mount/cree-edge-series-5>

4M



RESTL Test Report #: PL10270-001B
ARE-EDG-4M--06-E-UL-525-40K
Initial Delivered Lumens: 10,483




SEC-EDG-4M--06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 12,425
Initial FC at grade

Type IV Medium Distribution				
LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	2,501	B1 U0 G1	2,551	B1 U0 G1
04	5,003	B2 U0 G1	5,102	B2 U0 G1
06	7,418	B2 U0 G2	7,565	B2 U0 G2
08	9,891	B2 U0 G2	10,087	B2 U0 G2
10	12,334	B3 U0 G3	12,578	B3 U0 G3
12	14,801	B3 U0 G3	15,094	B3 U0 G3
525mA				
02	3,550	B1 U0 G1	3,624	B1 U0 G1
04	7,099	B2 U0 G2	7,248	B2 U0 G2
06	10,527	B2 U0 G2	10,748	B2 U0 G2
08	14,037	B3 U0 G3	14,331	B3 U0 G3
700mA				
02	4,189	B1 U0 G1	4,275	B1 U0 G1
04	8,379	B2 U0 G2	8,549	B2 U0 G2
06	12,425	B3 U0 G3	12,678	B3 U0 G3


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>

4MB



RESTL Test Report #: PL01023-002B
ARE-EDG-4MB--06-E-UL-525-40K
Initial Delivered Lumens: 7,985



SEC-EDG-4MB--06-E-UL-700-40K
Mounting Height: 10' (3.0m) A.F.G.
Initial Delivered Lumens: 9,359
Initial FC at grade

Type IV Medium Distribution w/BLS				
LED Count (x10)	4000K		5700K	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
350mA				
02	1,884	B0 U0 G1	1,921	B0 U0 G1
04	3,768	B1 U0 G1	3,843	B1 U0 G1
06	5,588	B1 U0 G1	5,698	B1 U0 G2
08	7,450	B1 U0 G2	7,598	B1 U0 G2
10	9,291	B1 U0 G2	9,475	B1 U0 G2
12	11,149	B1 U0 G2	11,370	B1 U0 G2
525mA				
02	2,674	B0 U0 G1	2,730	B0 U0 G1
04	5,348	B1 U0 G1	5,460	B1 U0 G1
06	7,930	B1 U0 G2	8,096	B1 U0 G2
08	10,573	B1 U0 G2	10,794	B1 U0 G2
700mA				
02	3,156	B1 U0 G1	3,220	B1 U0 G1
04	6,311	B1 U0 G2	6,440	B1 U0 G2
06	9,359	B1 U0 G2	9,549	B1 U0 G2

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>

LR6™

Six-Inch LED Downlight

Product Description

The LR6™ LED downlight delivers 650 lumens of exceptional 90+ CRI light while achieving over 60 lumens per watt. This breakthrough performance is achieved by combining the high efficacy and high-quality light of Cree TrueWhite® Technology. The LR6 is available in warm or neutral color temperatures and has a variety of trim options. It easily installs into most standard six-inch recessed IC or non-IC housings, making the LR6 perfect for use in commercial new construction or retrofit applications.

Performance Summary

Utilizes Cree TrueWhite® Technology

Active Color Management

Delivered Light Output: 650 lumens

Input Power: 10.5 watts

CRI: 90

CCT: 2700K, 3500K

Warranty: 10 years†

Lifetime: Designed to last 50,000 hours

Dimming: Dimmable to 20%*

Ordering Information

Example: LR6

Product
LR6 2700K, Edison Base
LR6-GU24 2700K, GU24 Base
LR6C 3500K, Edison Base
LR6C-GU24 3500K, GU24 Base

Housings & Accessories

Reference Housing & Accessory documents for more details.


Trims	
LT6A Diffuse anodized finish	LT6AB Black anodized finish
LT6AW Wheat diffuse anodized finish	LT6WH Smooth white
LT6AP Pewter diffuse anodized finish	LT6BB Flat black finish trim and reflector

Housings (Edison or GU24)	
H6 Architectural	SC6 Cylindrical Surface Mount
RC6 New Construction	SC6-CM Cylindrical Cord Mount
RR6 Retrofit	SC6-WM Cylindrical Wall Mount

* Reference www.cree.com/lighting for recommended dimmers.

† See www.cree.com/lighting for warranty terms.

LR6

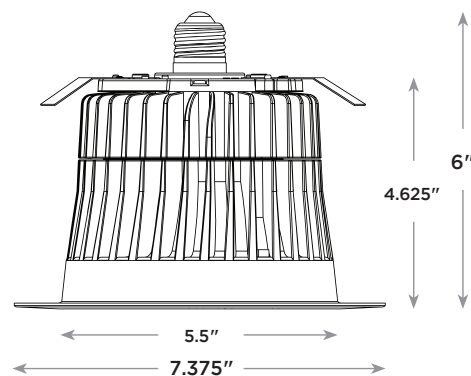

Rev. Date 12/19/2012



Product Specifications

CREE TRUEWHITE® TECHNOLOGY

A revolutionary way to generate high-quality white light, Cree TrueWhite® Technology mixes the light from the highest performing red and unsaturated yellow LEDs. This patented approach delivers an exclusive combination of 90+ CRI, beautiful light characteristics, and lifelong color consistency, all while maintaining high luminous efficacy—a true no compromise solution.

CONSTRUCTION & MATERIALS

- Durable die-cast aluminum housing protects LEDs, driver and power supply. Adjustable flip clips resist heat while providing retention for flush ceiling fit.
- Thermal management system uses integral heat sink to conduct heat away from LEDs and transfer it to the plenum space for optimal performance. LED junction temperatures stay below specified maximum even when installed in attic insulation with ambient temperatures exceeding 60 C.
- Suitable for insulated and non-insulated ceilings.
- One-piece aluminum lower reflector redirects light while also conducting heat away from LEDs. It creates a comfortable visual transition from the lens to the ceiling plane and easily accommodates LT6 snap-in trims.

OPTICAL SYSTEM

- Unique combination of reflective and refractive optical components achieves a uniform, comfortable appearance while eliminating pixelation and color fringing. This ensures smooth light patterns are projected with no hot spots and minimal striations.
- Components work together to optimize distribution, balancing the delivery of high illuminance levels on horizontal surfaces with an ideal amount of light on walls and vertical surfaces. This increases the perception of spaciousness.
- Diffusing lens shields direct view of LEDs while lower reflector balances brightness of lens with the ceiling to create a low-glare high angle appearance.

ELECTRICAL SYSTEM


- Integral, high-efficiency driver and power supply.
- **Power Factor** > 0.9 nominal
- **Input Voltage:** 120V, 60Hz
- **Dimming:** Dimmable to 20% with certain incandescent dimmers. Reference www.cree.com/lighting for recommended dimmers.

REGULATORY & VOLUNTARY QUALIFICATIONS

- ENERGY STAR® qualified.
- cULus Listed
- Exceeds California Title-24 high efficacy luminaire requirements.
- Suitable for damp locations.

Photometry

LR6 LIGHTING SCIENCES INC. CERTIFIED TEST #: 22226

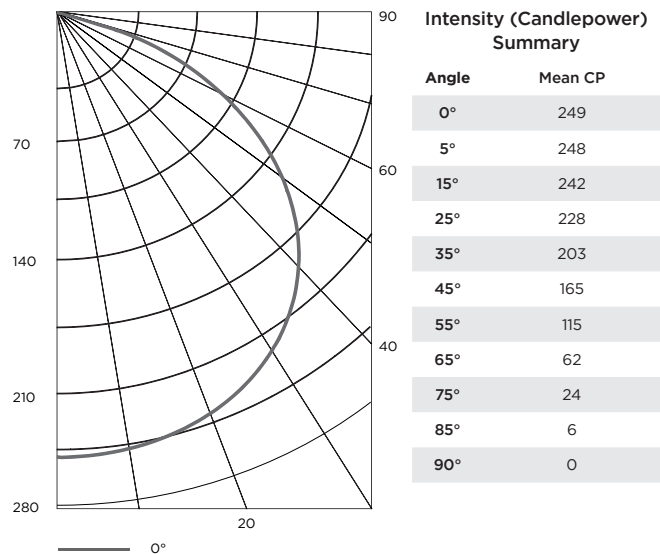

Zonal Lumen Summary

Zone	Lumens	% Lamp	% Fix
0-30	197	30.39%	30.39%
0-40	325	49.94%	49.94%
0-60	556	85.35%	85.35%
0-90	650	100%	100%


Reference www.cree.com/lighting for detailed photometric data.

Installation

- Designed to easily install in standard 6" downlight housings from Cree and other manufacturers.*
- Quick install system utilizes a unique retention feature. Simply attach socket to LR6. Move light to ready position and slide into housing.

NOTE: Reference www.cree.com/lighting for detailed installation instructions.

*Reference www.cree.com/lighting for a list of compatible housings.



Application Reference

Open Space					
Spacing	Lumens	Wattage	LPW	w/ft²	Average FC
4 x 4	650	10.5	62	0.60	38
6 x 6				0.28	18
8 x 8				0.15	9
10 x 10				0.10	6

10' Ceiling, 80/50/20 Reflectances, 2.5 workplane.
LLF: 1.0 Initial. Open Space: 50' x 40' x 10'

Corridor					
Spacing	Lumens	Wattage	LPW	w/ft²	Average FC
4' on Center	650	10.5	62	0.40	12
6' on Center				0.27	8
8' on Center				0.20	6
10' on Center				0.17	5

10' Ceiling, 80/50/20 Reflectances, Light levels on the ground.
LLF: 1.0 Initial. Corridor: 6' Wide x 100' Long

OSQ Series

OSQ™ LED Area/Flood Luminaire featuring Cree TrueWhite® Technology – Medium

Rev. Date: V25 03/31/2020

Product Description

The OSQ™ Area/Flood luminaire blends extreme optical control, advanced thermal management and modern, clean aesthetics. Built to last, the housing is rugged cast aluminum with an integral, weathertight LED driver compartment. Versatile mounting configurations offer simple installation. Its slim, low-profile design minimizes wind load requirements and blends seamlessly into the site providing even, quality illumination. The 'B' Input power designator is a suitable upgrade for HID applications up to 250 Watt, and the 'K' Input power designator is a suitable upgrade for HID applications up to 400 Watt.

Applications: Parking lots, walkways, campuses, car dealerships, office complexes, tunnels, underpasses, and internal roadways

Performance Summary

Utilizes Cree TrueWhite® Technology on 5000K Luminaires

NanoOptic® Precision Delivery Grid™ optic

Assembled in the U.S.A. of U.S. and imported parts

Initial Delivered Lumens: Up to 17,291

Efficacy: Up to 136 LPW

CRI: Minimum 70 CRI (3000K, 4000K & 5700K); 90 CRI (5000K)

CCT: 3000K, 4000K, 5000K, 5700K

Limited Warranty*: 10 years on luminaire; 10 years on Colorfast DeltaGuard® finish; up to 5 years for Synapse® accessories; 1 year on luminaire accessories

* See <http://creelighting.com/warranty> for warranty terms. For Synapse accessories, consult Synapse spec sheets for details on warranty terms.

Ordering Information

Fully assembled luminaire is composed of two components that must be ordered separately:

Example: **Mount:** OSQ-B-AASV + **Luminaire:** OSQ-A-NM-2ME-B-40K-UL-SV


Mount (Luminaire must be ordered separately)*	
OSQ-	
OSQ-B-AA Adjustable Arm	Color Options: SV Silver BK Black BZ Bronze WH White
OSQ-DA Direct Arm	
OSQ-M-TSP Transportation Mount (stainless steel; do not specify color)	
OSQ-TM Trunnion Mount	

* Reference EPA and pole configuration suitability data beginning on page 9

Luminaire (Mount must be ordered separately)											
OSQ	A	NM									
Product	Version	Mounting	Optic	Input Power Designator	CCT	Voltage	Color Options	Options			
OSQ	A	NM No Mount	Asymmetric	2ME*	4ME*	B 86W K 130W Z 53W	30K 3000K, 70 CRI 40K 4000K, 70 CRI 50K 5000K, 90 CRI 57K 5700K, 70 CRI	UL Universal 120-277V UH Universal 347-480V - Available with B & K Input Power Designators only	BK Black BZ Bronze SV Silver WH White	PML Programmable Multi-Level, up to 40' Mounting Height - Refer to PML spec sheet for details - Intended for downlight applications at 0° tilt PML2 Programmable Multi-Level, 10-30' Mounting Height - Refer to PML spec sheet for details - Intended for downlight applications at 0° tilt Q9/Q6/Q5/Q4/Q3/Q2/Q1 Field Adjustable Output - Must select Q9, Q6, Q5, Q4, Q3, Q2, or Q1 - Offers full range adjustability - Refer to pages 11-12 for power and lumen values - Available with B & K Input Power Designators only - Not available with PML or PML2 options	R NEMA® 7-Pin Photocell Receptacle - 7-pin receptacle per ANSI C136.41 - Intended for downlight applications with maximum 45° tilt - Factory connected 0-10V dim leads - 18" (457mm) seven-conductor cord exits luminaire - Requires photocell or shorting cap by others
				Type II Medium	Type IV Medium						
			Symmetric	5ME	25D	RL Rotate Left - LED and optic are rotated to the left - Refer to RR/RL configuration diagram on page 13 for optic directionality RR Rotate Right - LED and optic are rotated to the right - Refer to RR/RL configuration diagram on page 13 for optic directionality					
				Type V Medium	25° Flood						
				40D	40° Flood						
				5SH	40° Flood						
				Type V Short	60D						
				60° Flood							
				WSN	Wide Sign						
				15D	15° Flood						

* Available with Backlight Shield when ordered with field-installed accessory (see table above)

DA Mount

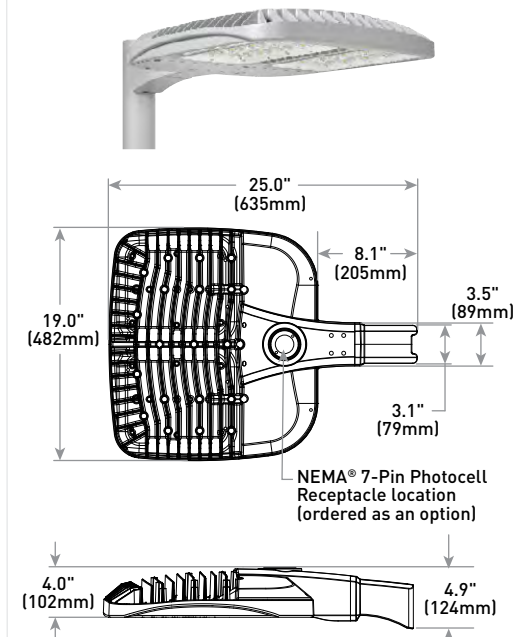

Weight

28.9 lbs. (13.1kg)



US: creelighting.com (800) 236-6800

Canada: creelighting-canada.com (800) 473-1234

Product Specifications

CREE TRUEWHITE® TECHNOLOGY

A revolutionary way to generate high-quality white light, Cree TrueWhite® Technology is a patented approach that delivers an exclusive combination of 90+ CRI, beautiful light characteristics and lifelong color consistency, all while maintaining high luminous efficacy – a true no compromise solution.

CONSTRUCTION & MATERIALS

- Slim, low profile design minimizes wind load requirements
- Luminaire housing is rugged die cast aluminum with an integral, weathertight LED driver compartment and high-performance heat sink
- Convenient interlocking mounting method on direct arm mount. Mounting adaptor is rugged die cast aluminum and mounts to 3" (76mm) or larger square or round pole, secured by two 5/16-18 UNC bolts spaced on 2" (51mm) centers
- Mounting for the adjustable arm mount adaptor is rugged die cast aluminum and mounts to 2" (51mm) IP, 2.375" (60mm) O.D. tenon
- Adjustable arm mount can be adjusted 180° in 2.5° increments
- Transportation mount is constructed of 316 stainless steel and mounts to surface with (4) 3/8" fasteners by others
- Trunnion mount is constructed of A500 and A1011 steel and is adjustable from 0-180° in 15° degree increments. Trunnion mount secures to surface with (1) 3/4" bolt or (2) 1/2" or 3/8" bolts
- Includes 18" (340mm) 18/5 or 16/5 cord exiting the luminaire. When ordered with R option, 18" (340mm) 18/7 or 16/7 cord is provided
- Designed for uplight and downlight applications
- Exclusive Colorfast DeltaGuard® finish features an E-Coat epoxy primer with an ultra-durable powder topcoat, providing excellent resistance to corrosion, ultraviolet degradation and abrasion. Silver, bronze, black, and white are available
- Weight:** OSQ-DA: 28.9 lbs. (13.1kg); OSQ-B-AA: 28.4 lbs. (12.9kg); OSQ-M-TSP: 42 lbs. (19.1kg); OSQ-TM: 32.6 lbs. (14.8kg)

ELECTRICAL SYSTEM

- Input Voltage:** 120-277V or 347-480V, 50/60Hz, Class 1 drivers
- Power Factor:** > 0.9 at full load
- Total Harmonic Distortion:** < 20% at full load
- Integral 10kV surge suppression protection standard
- When code dictates fusing, a slow blow fuse or type C/D breaker should be used to address inrush current
- Consult factory if in-luminaire fusing is required
- Designed with 0-10V dimming capabilities. Controls by others
- Refer to Dimming spec sheet for details
- Maximum 10V Source Current:** 1.0mA

REGULATORY & VOLUNTARY QUALIFICATIONS

- cULus Listed
- Suitable for wet locations
- Enclosure rated IP66 per IEC 60529 when ordered without R option
- Consult factory for CE Certified products
- Certified to ANSI C136.31-2001, 3G bridge and overpass vibration standards with AA, DA, TM, and TSP mounts
- ANSI C136.2 10kV surge protection, tested in accordance with IEEE/ANSI C62.41.2
- Meets FCC Part 15, Subpart B, Class A limits for conducted and radiated emissions
- Luminaire and finish endurance tested to withstand 5,000 hours of elevated ambient salt fog conditions as defined in ASTM Standard B 117
- Meets Buy American requirements within ARRA
- DLC and DLC Premium qualified versions available with 70 CRI. Some exceptions apply. Please refer to <https://www.designlights.org/search/> for most current information
- RoHS compliant. Consult factory for additional details
- Dark Sky Friendly, IDA Approved when ordered with 30K CCT and direct or transportation mounts only. Please refer to <https://www.darksky.org/our-work/lighting/lighting-for-industry/fsa/fsa-products/> for most current information

 **CA RESIDENTS WARNING:** Cancer and Reproductive Harm – www.p65warnings.ca.gov

Product Specifications

SYNAPSE® SIMPLYSNAP INTELLIGENT CONTROL

The Synapse SimplySNAP platform is a highly intuitive connected lighting solution featuring zone dimming, motion sensing, and daylight harvesting with utility-grade power monitoring and support of up to 1000 nodes per gateway. The system features a reliable and robust self-healing mesh network with a browser-based interface that runs on smartphones, tablets, and PCs. The Twist-Lock Lighting Controller (TL7-B2) and Site Controller (SS450-002) take the OSQ Series to a new performance plateau, providing extreme energy productivity, code compliance and a better light experience.

Electrical Data*							
Input Power Designator	System Watts 120-480V	Total Current (A)					
		120V	208V	240V	277V	347V	480V
B	86	0.73	0.43	0.37	0.32	0.25	0.19
K	130	1.09	0.65	0.56	0.49	0.38	0.28
Z	53**	0.46	0.26	0.22	0.19	N/A	N/A

* Electrical data at 25°C (77°F). Actual wattage may differ by +/- 10% when operating between 120-277V or 347-480V +/- 10%

** Available with UL voltage only

OSQ Series Ambient Adjusted Lumen Maintenance¹						
Ambient	Optic	Initial LMF	25K hr Reported² LMF	50K hr Reported² LMF	75K hr Reported² LMF	100K hr Reported² LMF
5°C (41°F)	Asymmetric	1.04	1.03	1.01	0.99	0.97
	Symmetric	1.05	1.04	1.03	1.03	1.02
10°C (50°F)	Asymmetric	1.03	1.02	1.00	0.98	0.96
	Symmetric	1.04	1.03	1.02	1.01	1.00
15°C (59°F)	Asymmetric	1.02	1.01	0.99	0.97	0.95
	Symmetric	1.02	1.02	1.01	1.00	0.99
20°C (68°F)	Asymmetric	1.01	1.00	0.98	0.96	0.94
	Symmetric	1.01	1.01	1.00	0.99	0.98
25°C (77°F)	Asymmetric	1.00	0.99	0.97	0.95	0.93
	Symmetric	1.00	0.99	0.98	0.98	0.97

¹ Lumen maintenance values at 25°C (77°F) are calculated per IES TM-21 based on IES LM-80 report data for the LED package and in-situ luminaire testing. Luminaire ambient temperature factors (LATF) have been applied to all lumen maintenance factors. Please refer to the [Temperature Zone Reference Document](#) for outdoor average nighttime ambient conditions.

² In accordance with IES TM-21, Reported values represent interpolated values based on time durations that are up to 6x the tested duration in the IES LM-80 report for the LED.

Accessories


Field-Installed			
Backlight Shield OSQ-BLSMF - Front facing optics OSQ-BLSMR - Rotated optics	Hand-Held Remote XA-SENSREM - For successful implementation of the programmable multi-level option, a minimum of one hand-held remote is required	Bird Spikes OSQ-MED-BRDSPK	Shorting Cap XA-XLSHRT
Synapse Wireless Control Accessories			
Twist-Lock Lighting Controller TL7-B2 - Suitable for 120-277V (UL) voltage only - Requires NEMA/ANSI C136.41 7-Pin Dimming Receptacle - Not for use with PML or Q options - Provides On/Off switching, dimming, power metering, digital sensor input, and status monitoring of luminaires - Refer to TL7-B2 spec sheet for details SimplySNAP Central Base Station CBSSW-450-002 - Includes On-Site Controller (SS450-002) and 5-button switch - Indoor and Outdoor rated - Refer to CBSSW-450-002 spec sheet for details Synapse Wireless Sensor WSN-DPM - Motion and light sensor - Control multiple zones - Refer to WSN-DPM spec sheet for details		SimplySNAP On-Site Controller SS450-002 - Verizon® LTE-enabled - Designed for indoor applications - Refer to SS450-002 spec sheet for details Building Management System (BMS) Gateway BMS-GW-002 - Required for BACnet integration - Refer to BMS-GW-002 spec sheet for details Outdoor Antennas (Optional, for increased range, 8dB gain) KIT-ANT420SM - Kit includes antenna, 20' cable and bracket KIT-ANT360 - Kit includes antenna, 30' cable and bracket KIT-ANT600 - Kit includes antenna, 50' cable and bracket - Refer to Outdoor antenna spec sheet for details	

OSQ™ LED Area/Flood Luminaire featuring Cree TrueWhite® Technology – Medium


Photometry

All published luminaire photometric testing performed to IES LM-79-08 standards. To obtain an IES file specific to your project consult:
<https://creelighting.com/products/outdoor/area/osq-series>

2ME



RESTL Test Report #: PL08877-001A
 OSQ-A**-2ME-B-40K-UL
 Initial Delivered Lumens: 10,381




OSQ-A**-2ME-B-40K-UL
 Mounting Height: 25' (7.6m) A.F.G.
 Initial Delivered Lumens: 11,424
 Initial FC at grade


Type II Medium Distribution								
Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	10,738	B2 U0 G2	11,424	B2 U0 G2	9,350	B2 U0 G2	11,648	B2 U0 G2
K	16,022	B3 U0 G3	16,959	B3 U0 G3	14,000	B3 U0 G2	17,291	B3 U0 G3
Z	6,481	B2 U0 G1	6,896	B2 U0 G1	5,750	B1 U0 G1	7,031	B2 U0 G1

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt



CESTL Test Report #: PL07700-001A
 OSQ-A**-2ME-U-57K-UL w/OSQ-BLSLF
 Initial Delivered Lumens: 22,822



OSQ-A**-2ME-U-57K-UL w/OSQ-BLSLF
 Mounting Height: 25' (7.6m) A.F.G.
 Initial Delivered Lumens: 8,779
 Initial FC at grade

Type II Medium w/BLS Distribution								
Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM 15 11	Initial Delivered Lumens*	BUG Ratings** Per TM 15 11	Initial Delivered Lumens*	BUG Ratings** Per TM 15 11	Initial Delivered Lumens*	BUG Ratings** Per TM 15 11
B	8,251	B2 U0 G2	8,779	B2 U0 G2	7,200	B1 U0 G1	8,950	B2 U0 G2
K	12,312	B2 U0 G2	13,032	B2 U0 G2	10,750	B2 U0 G2	13,286	B2 U0 G2
Z	4,980	B1 U0 G1	5,299	B1 U0 G1	4,420	B1 U0 G1	5,402	B1 U0 G1


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt


Photometry

All published luminaire photometric testing performed to IES LM-79-08 standards. To obtain an IES file specific to your project consult:
<https://creelighting.com/products/outdoor/area/osq-series>

3ME



RESTL Test Report #: PL08876-001A
 OSQ-A-**-3ME-B-30K-UL
 Initial Delivered Lumens: 10,421




OSQ-A-**-3ME-B-40K-UL
 Mounting Height: 25' (7.6m) A.F.G.
 Initial Delivered Lumens: 11,424
 Initial FC at grade

Type III Medium Distribution


Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	10,738	B3 U0 G3	11,424	B3 U0 G3	9,350	B2 U0 G2	11,648	B3 U0 G3
K	16,022	B3 U0 G3	16,959	B3 U0 G3	14,000	B3 U0 G3	17,291	B3 U0 G3
Z	6,481	B2 U0 G2	6,896	B2 U0 G2	5,750	B2 U0 G2	7,031	B2 U0 G2

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt



CESTL Test Report #: PL07699-001A
 OSQ-A-**-3ME-U-57K-UL w/OSQ-BLSLF
 Initial Delivered Lumens: 23,601



OSQ-A-**-3ME-B-40K-UL w/OSQ-BLSMF
 Mounting Height: 25' (7.6m) A.F.G.
 Initial Delivered Lumens: 9,019
 Initial FC at grade

Type III Medium w/BLS Distribution

Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	8,477	B1 U0 G2	9,019	B1 U0 G2	7,400	B1 U0 G2	9,196	B1 U0 G2
K	12,649	B2 U0 G2	13,389	B2 U0 G2	11,050	B2 U0 G2	13,650	B2 U0 G2
Z	5,117	B1 U0 G1	5,444	B1 U0 G1	4,540	B1 U0 G1	5,551	B1 U0 G1

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens


** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

OSQ™ LED Area/Flood Luminaire featuring Cree TrueWhite® Technology – Medium


Photometry

All published luminaire photometric testing performed to IES LM-79-08 standards. To obtain an IES file specific to your project consult:
<https://creelighting.com/products/outdoor/area/osq-series>

4ME



RESTL Test Report #: PL08878-001A
 OSQ-A-**-4ME-B-30K-UL
 Initial Delivered Lumens: 10,230




OSQ-A-**-4ME-B-40K-UL
 Mounting Height: 25' (7.6m) A.F.G.
 Initial Delivered Lumens: 11,424
 Initial FC at grade


Type IV Medium Distribution								
Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	10,738	B2 U0 G2	11,424	B2 U0 G2	9,350	B2 U0 G2	11,648	B2 U0 G2
K	16,022	B3 U0 G3	16,959	B3 U0 G3	14,000	B3 U0 G3	17,291	B3 U0 G3
Z	6,481	B2 U0 G2	6,896	B2 U0 G2	5,750	B2 U0 G1	7,031	B2 U0 G2

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt



CESTL Test Report #: PL07692-001A
 OSQ-A-**-4ME-U-57K-UL w/OSQ-BLSLF
 Initial Delivered Lumens: 22,793



OSQ-A-**-4ME-B-40K-UL w/OSQ-BLSMF
 Mounting Height: 25' (7.6m) A.F.G.
 Initial Delivered Lumens: 8,779
 Initial FC at grade

Type IV Medium w/BLS Distribution								
Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	8,251	B1 U0 G2	8,779	B1 U0 G2	7,200	B1 U0 G2	8,950	B1 U0 G2
K	12,312	B2 U0 G2	13,032	B2 U0 G2	10,750	B2 U0 G2	13,286	B2 U0 G2
Z	4,980	B1 U0 G1	5,299	B1 U0 G1	4,420	B1 U0 G1	5,402	B1 U0 G1

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens


** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

Photometry


All published luminaire photometric testing performed to IES LM-79-08 standards. To obtain an IES file specific to your project consult:

<https://creelighting.com/products/outdoor/area/osq-series>

5ME



RESTL Test Report #: PL08534-001B
OSQ-A**-5ME-B-40K-UL
Initial Delivered Lumens: 10,519



OSQ-A**-5ME-B-40K-UL
Mounting Height: 25' (7.6m) A.F.G.
Initial Delivered Lumens: 10,867
Initial FC at grade


Type V Medium Distribution

Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	10,232	B4 U0 G3	10,867	B4 U0 G3	10,000	B4 U0 G3	11,056	B4 U0 G3
K	15,063	B4 U0 G4	15,999	B4 U0 G4	14,925	B4 U0 G4	16,277	B4 U0 G4
Z	5,257	B3 U0 G3	6,086	B3 U0 G3	6,175	B3 U0 G3	6,192	B3 U0 G3


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

5SH



CESTL Test Report #: PL10754-001A
OSQ-A**-5SH-B-40K-UL
Initial Delivered Lumens: 25,679



OSQ-A**-5SH-B-40K-UL
Mounting Height: 25' (7.6m) A.F.G.
Initial Delivered Lumens: 11,478
Initial FC at grade

Type V Short Distribution

Input Power Designator	3000K (70 CRI)		4000K (70 CRI)		5000K (90 CRI)		5700K (70 CRI)	
	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11	Initial Delivered Lumens*	BUG Ratings** Per TM-15-11
B	10,806	B4 U0 G2	11,478	B4 U0 G2	10,575	B4 U0 G2	11,678	B4 U0 G2
K	15,909	B4 U0 G3	16,897	B4 U0 G3	15,800	B4 U0 G3	17,191	B4 U0 G3
Z	5,552	B3 U0 G1	6,428	B3 U0 G2	6,525	B3 U0 G2	6,539	B3 U0 G2

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens


** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit: <https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

OSQ™ LED Area/Flood Luminaire featuring Cree TrueWhite® Technology – Medium


Photometry

All published luminaire photometric testing performed to IES LM-79-08 standards. To obtain an IES file specific to your project consult:
<https://creelighting.com/products/outdoor/area/osq-series>

15D



CESTL Test Report #: PL07689-001A
 OSQ-A-**-15D-U-30K-UL
 Initial Delivered Lumens: 23,254



OSQ-A-**-15D-B-40K-UL
 Mounting Height: 25' (7.6m) A.F.G., 60° Tilt
 Initial Delivered Lumens: 11,478
 Initial FC at grade


15° Flood Distribution

Input Power Designator	3000K (70 CRI)	4000K (70 CRI)	5000K (90CRI)	5700K (70 CRI)
	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*
B	10,806	11,478	10,575	11,678
K	15,909	16,897	15,800	17,191
Z	5,552	6,428	6,525	6,539


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

25D



CESTL Test Report #: PL07696-001A
 OSQ-A-**-25D-U-30K-UL
 Initial Delivered Lumens: 23,265



OSQ-A-**-25D-B-40K-UL
 Mounting Height: 25' (7.6m) A.F.G., 60° Tilt
 Initial Delivered Lumens: 11,478
 Initial FC at grade


25° Flood Distribution

Input Power Designator	3000K (70 CRI)	4000K (70 CRI)	5000K (90CRI)	5700K (70 CRI)
	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*
B	10,806	11,478	10,575	11,678
K	15,909	16,897	15,800	17,191
Z	5,552	6,428	6,525	6,539


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

40D



CESTL Test Report #: PL07697-001A
 OSQ-A-**-40D-U-30K-UL
 Initial Delivered Lumens: 22,943



OSQ-A-**-40D-B-40K-UL
 Mounting Height: 25' (7.6m) A.F.G., 60° Tilt
 Initial Delivered Lumens: 11,478
 Initial FC at grade

40° Flood Distribution

Input Power Designator	3000K (70 CRI)	4000K (70 CRI)	5000K (90 CRI)	5700K (70 CRI)
	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*
B	10,806	11,478	10,575	11,678
K	15,909	16,897	15,800	17,191
Z	5,552	6,428	6,525	6,539


* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens

** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt


Photometry

All published luminaire photometric testing performed to IES LM-79-08 standards. To obtain an IES file specific to your project consult:
<https://creelighting.com/products/outdoor/area/osq-series>

60D



CESTL Test Report #: PL08100-001B
OSQ-A-**-60D-B-30K-UL
Initial Delivered Lumens: 10,079




OSQ-A-**-60D-B-40K-UL
Mounting Height: 25' (7.6m) A.F.G., 60° Tilt
Initial Delivered Lumens: 11,478
Initial FC at grade


60° Flood Distribution				
Input Power Designator	3000K (70 CRI)	4000K (70 CRI)	5000K (90 CRI)	5700K (70 CRI)
	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*
B	10,806	11,478	10,575	11,678
K	15,909	16,897	15,800	17,191
Z	5,552	6,428	6,525	6,539

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens
** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

WSN



CESTL Test Report #: PL07695-001A
OSQ-A-**-WSN-U-30K-UL
Initial Delivered Lumens: 23,116



OSQ-A-**-WSN-B-40K-UL
Mounting Height: 25' (7.6m) A.F.G., 60° Tilt
Initial Delivered Lumens: 11,478
Initial FC at grade

Wide Sign Distribution				
Input Power Designator	3000K (70 CRI)	4000K (70 CRI)	5000K (90 CRI)	5700K (70 CRI)
	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*	Initial Delivered Lumens*
B	10,806	11,478	10,575	11,678
K	15,909	16,897	15,800	17,191
Z	5,552	6,428	6,525	6,539

* Initial delivered lumens at 25°C (77°F). Actual production yield may vary between -10 and +10% of initial delivered lumens
** For more information on the IES BUG (Backlight-Uplight-Glare) Rating visit:
<https://www.ies.org/wp-content/uploads/2017/03/TM-15-11BUGRatingsAddendum.pdf>. Valid with no tilt

OSQ™ LED Area/Flood Luminaire featuring Cree TrueWhite® Technology – Medium

Luminaire EPA

Adjustable Arm Mount – OSQ-B-AA Weight: 28.4 lbs. (12.9kg)							
Single	2 @ 180°	2 @ 90°	3 @ 90°	3 @ 120°	3 @ 180°	4 @ 180°	4 @ 90°
Tenon Configuration [0° -80° Tilt]; If used with Cree Lighting tenons, please add tenon EPA with Luminaire EPA							
							
PB-1A*; PT-1; PW-1A3**	PB-2A*; PB-2R2.375; PD-2A4(180); PT-2(180); PW-2A3**	PB-2A*; PD-2A4(90); PT-2(90)	PB-3A*; PD-3A4(90); PT-3(90)	PB-3A*; PT-3(120)	PB-3A*; PB-3R2.375	PB-4A*(180)	PB-4A*(90); PB-4R2.375; PD-4A4(90); PT-4(90)
0° Tilt							
0.74	1.48	1.19	1.93	1.63	3.33	4.66	2.38
10° Tilt							
0.75	1.48	1.49	2.23	2.15	4.22	5.84	2.98
20° Tilt							
1.12	1.48	1.86	2.60	2.85	5.31	7.32	3.72
30° Tilt							
1.46	1.48	2.20	2.94	3.56	6.34	8.68	4.40
45° Tilt							
1.96	1.96	2.69	3.43	4.54	7.83	10.68	5.38
60° Tilt							
2.33	2.33	3.07	3.81	5.11	8.94	12.16	6.14
70° Tilt							
2.49	2.49	3.23	3.97	5.11	9.43	12.80	6.46
80° Tilt							
2.58	2.58	3.32	4.06	5.11	9.71	13.16	6.64
Tenon Configuration [90° Tilt]; If used with Cree Lighting tenons, please add tenon EPA with Luminaire EPA							
PB-1A*; PT-1; PW-1A3**	PB-2A*; PB-2R2.375; PD-2A4(180); PT-2(180); PW-2A3**	PB-2A*	PB-3A*	PB-3A*; PT-3(120)	PB-3A*; PB-3R2.375	PB-4A*(180)	PB-4A*(90); PB-4R2.375
90° Tilt							
2.61	2.61	4.44	6.05	5.11	9.79	13.28	10.39

* Specify pole size: 3 [3"], 4 [4"], 5 [5"], or 6 [6"] for single, double or triple luminaire orientation or 4 [4"], 5 [5"], or 6 [6"] for quad luminaire orientation
 ** These EPA values must be multiplied by the following ratio: Fixture Mounting Height/Total Pole Height. Specify pole size: 3 [3"], 4 [4"], 5 [5"], or 6 [6"]

Tenon EPA

Part Number	EPA
PB-1A*	None
PB-2A*	0.82
PB-3A*	1.52
PB-4A*(180)	2.22
PB-4A*(90)	1.11
PB-2R2.375	0.92
PB-3R2.375	1.62
PB-4R2.375	2.32
PD Series Tenons	0.09
PT Series Tenons	0.10
PW-1A3**	0.47
PW-2A3**	0.94
WM-2	0.08
WM-4	0.25
WM-DM	None

* Specify pole size: 3 [3"], 4 [4"], 5 [5"], or 6 [6"] for single, double or triple luminaire orientation or 4 [4"], 5 [5"], or 6 [6"] for quad luminaire orientation
 ** These EPA values must be multiplied by the following ratio: Fixture Mounting Height/Total Pole Height. Specify pole size: 3 [3"], 4 [4"], 5 [5"], or 6 [6"]

Tenons and Brackets* (must specify color)	
Square Internal Mount Vertical Tenons (Steel) - Mounts to 3-6" (76-152mm) square aluminum or steel poles PB-1A* – Single PB-4A*(90) – 90° Quad PB-2A* – 180° Twin PB-4A*(180) – 180° Quad PB-3A* – 180° Triple	Round External Mount Vertical Tenons (Steel) - Mounts to 2.375" (60mm) O.D. round aluminum or steel poles or tenons PB-2R2.375 – Twin PB-4R2.375 – Quad PB-3R2.375 – Triple
Square Internal Mount Horizontal Tenons (Aluminum) - Mounts to 4" (102mm) square aluminum or steel poles PD-2A4(90) – 90° Twin PD-3A4(90) – 90° Triple PD-2A4(180) – 180° Twin PD-4A4(90) – 90° Quad	Round External Mount Horizontal Tenons (Aluminum) - Mounts to 2.375" (60mm) O.D. round aluminum or steel poles or tenons - Mounts to square pole with PB-1A* tenon PT-1 – Single (Vertical) PT-3(90) – 90° Triple PT-2(90) – 90° Twin PT-3(120) – 120° Triple PT-2(180) – 180° Twin PT-4(90) – 90° Quad
Wall Mount Brackets - Mounts to wall or roof WM-2 – Horizontal for OSQ-B-AA mount WM-4 – L-Shape for OSQ-B-AA mount WM-DM – Plate for OSQ-DA mount	Mid-Pole Bracket - Mounts to square pole PW-1A3** – Single PW-2A3** – Double
	Ground Mount Post - For ground-mounted flood luminaires PGM-1 – for OSQ-B-AA mount

* Refer to the [Bracket and Tenons spec sheet](#) for more details

Luminaire EPA

Direct Arm Mount – OSQ-DA Weight: 28.9 lbs. (13.1kg)					
Single	2 @ 180°	2 @ 90°	3 @ 90°	3 @ 120°	4 @ 90°
					
0.74	1.48	1.19	1.93	1.63	2.38

Direct Mount Configurations

Compatibility with OSQ-DA Direct Mount Bracket					
Input Power Designator	2 @ 90°	2 @ 180°	3 @ 90°	3 @ 120°	4 @ 90°
3" Square					
B, K & Z	N/A	✓	N/A	N/A	N/A
3" Round					
B, K & Z	N/A	✓	N/A	N/A	N/A
4" Square					
B, K & Z	✓	✓	✓	N/A	✓
4" Round					
B, K & Z	✓	✓	✓	✓	✓
5" Square					
B, K & Z	✓	✓	✓	N/A	✓
5" Round					
B, K & Z	✓	✓	✓	✓	✓
6" + Square					
B, K & Z	✓	✓	✓	N/A	✓
6" + Round					
B, K & Z	✓	✓	✓	✓	✓

Luminaire EPA

Trunnion Mount – OSQ-TM Weight: 32.6 lbs. (14.8kg)	
Single	
0° Tilt	
0.75	
15° Tilt	
0.99	
30° Tilt	
1.57	
45° Tilt	
2.07	
60° Tilt	
2.46	
75° Tilt	
2.67	
90° Tilt	
2.33	

Field Adjustable Output (Q9/Q6/Q5/Q4/Q3/Q2/Q1) Option Description:

The Field Adjustable Output option enables the OSQ area luminaires to be tuned to the exact needs of a particular application through multiple levels of adjustment. When ordered with the Q option, the luminaire will be shipped from the factory at the selected Q setting and will be fully adjustable between the nine settings.

Q Option Power & Lumen Data – Designator B

Q Option Setting	CCT/CRI	System Watts	Lumen Values						Optics Qualified on DLC QPL	
		120-480V	Asymmetric	5ME	5SH & Floods	2ME w/ BLS	3ME w/ BLS	4ME w/BLS	Standard	Premium
Q9 (Full Power)	30K (70 CRI)	86	10,738	10,232	10,806	8,251	8,477	8,251	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		11,424	10,867	11,478	8,779	9,019	8,779	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		9,350	10,000	10,575	7,200	7,400	7,200	TBD	TBD
	57K (70 CRI)		11,648	11,056	11,678	8,950	9,196	8,950	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q6	30K (70 CRI)	77	9,449	9,004	9,509	7,261	7,460	7,261	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		10,053	9,563	10,101	7,726	7,937	7,726	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		8,350	8,950	9,450	6,425	6,600	6,425	TBD	TBD
	57K (70 CRI)		10,250	9,729	10,277	7,876	8,092	7,876	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q5	30K (70 CRI)	72	8,913	8,492	8,969	6,848	7,036	6,848	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		9,482	9,020	9,527	7,287	7,486	7,287	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		7,525	8,050	8,525	5,775	5,950	5,775	TBD	TBD
	57K (70 CRI)		9,668	9,176	9,693	7,429	7,633	7,429	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q4	30K (70 CRI)	62	7,731	7,367	7,780	5,941	6,103	5,941	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		8,225	7,824	8,264	6,321	6,494	6,321	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		6,575	7,025	7,425	5,050	5,175	5,050	TBD	TBD
	57K (70 CRI)		8,387	7,960	8,408	6,444	6,621	6,444	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q3	30K (70 CRI)	53	6,550	6,241	6,592	5,033	5,171	5,033	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		6,969	6,629	7,002	5,355	5,502	5,355	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		5,575	5,975	6,325	4,290	4,410	4,290	TBD	TBD
	57K (70 CRI)		7,105	6,744	7,124	5,460	5,610	5,460	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q2	30K (70 CRI)	45	5,476	5,218	5,511	4,208	4,323	4,208	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		5,826	5,542	5,854	4,477	4,600	4,477	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		4,550	4,890	5,175	3,500	3,590	3,500	TBD	TBD
	57K (70 CRI)		5,940	5,639	5,956	4,565	4,690	4,565	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q1	30K (70 CRI)	34	4,188	3,990	4,214	3,218	3,306	3,218	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		4,455	4,238	4,476	3,424	3,517	3,424	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		3,500	3,770	3,980	2,690	2,760	2,690	TBD	TBD
	57K (70 CRI)		4,543	4,312	4,554	3,491	3,586	3,491	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN

Field Adjustable Output (Q9/Q6/Q5/Q4/Q3/Q2/Q1) Option Description:


The Field Adjustable Output option enables the OSQ area luminaires to be tuned to the exact needs of a particular application through multiple levels of adjustment. When ordered with the Q option, the luminaire will be shipped from the factory at the selected Q setting and will be fully adjustable between the nine settings.

Q Option Power & Lumen Data – Designator K


Q Option Setting	CCT/CRI	System Watts	Lumen Values						Optics Qualified on DLC QPL	
		120-480V	Asymmetric	5ME	5SH & Floods	2ME w/BLS	3ME w/BLS	4ME w/BLS	Standard	Premium
Q9 (Full Power)	30K (70 CRI)	130	16,022	15,063	15,909	12,312	12,649	12,312	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		16,959	15,999	16,897	13,032	13,389	13,032	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		14,000	14,925	15,800	10,750	11,050	10,750	TBD	TBD
	57K (70 CRI)		17,291	16,277	17,191	13,286	13,650	13,286	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q6	30K (70 CRI)	117	14,099	13,255	14,000	10,835	11,131	10,835	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		14,924	14,079	14,869	11,468	11,782	11,468	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		12,500	13,350	14,100	9,600	9,875	9,600	TBD	TBD
	57K (70 CRI)		15,216	14,324	15,128	11,692	12,012	11,692	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q5	30K (70 CRI)	110	13,298	12,502	13,204	10,219	10,499	10,219	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		14,076	13,279	14,025	10,817	11,113	10,817	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		11,250	12,050	12,725	8,650	8,900	8,650	TBD	TBD
	57K (70 CRI)		14,352	13,510	14,269	11,027	11,330	11,027	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q4	30K (70 CRI)	93	11,536	10,845	11,454	8,865	9,107	8,865	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		12,210	11,519	12,166	9,383	9,640	9,383	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		9,825	10,525	11,100	7,550	7,750	7,550	TBD	TBD
	57K (70 CRI)		12,450	11,719	12,378	9,566	9,828	9,566	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q3	30K (70 CRI)	80	9,773	9,188	9,704	7,510	7,716	7,510	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		10,345	9,759	10,307	7,950	8,167	7,950	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		8,350	8,950	9,475	6,425	6,600	6,425	TBD	TBD
	57K (70 CRI)		10,548	9,929	10,487	8,104	8,327	8,104	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q2	30K (70 CRI)	67	8,171	7,682	8,114	6,279	6,451	6,279	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		8,649	8,159	8,617	6,646	6,828	6,646	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		6,825	7,325	7,725	5,250	5,375	5,250	TBD	TBD
	57K (70 CRI)		8,818	8,301	8,767	6,776	6,962	6,776	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
Q1	30K (70 CRI)	51	6,249	5,875	6,205	4,802	4,933	4,802	5ME	2ME, 3ME, 4ME, 5SH, 15D, 25D, 40D, 60D, WSN
	40K (70 CRI)		6,614	6,240	6,590	5,082	5,222	5,082	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN
	50K (90 CRI)		5,250	5,650	5,975	4,030	4,150	4,030	TBD	TBD
	57K (70 CRI)		6,743	6,348	6,704	5,182	5,324	5,182	N/A	2ME, 3ME, 4ME, 5ME, 5SH, 15D, 25D, 40D, 60D, WSN

OSQ™ LED Area/Flood Luminaire featuring Cree TrueWhite® Technology – Medium



AA Mount

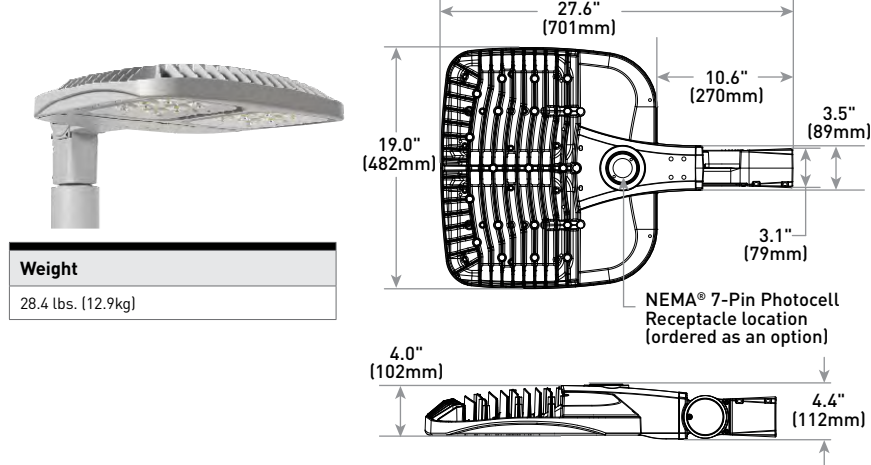



RR/RL Configuration

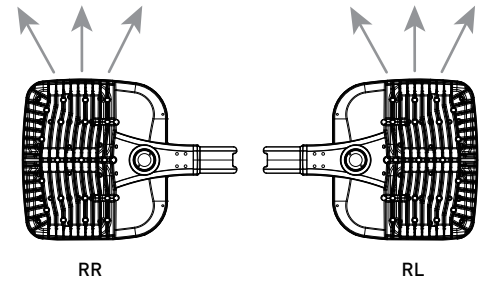

TSP Mount

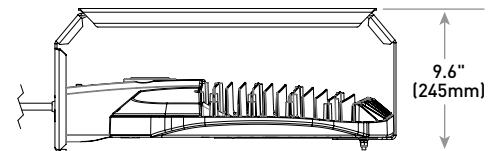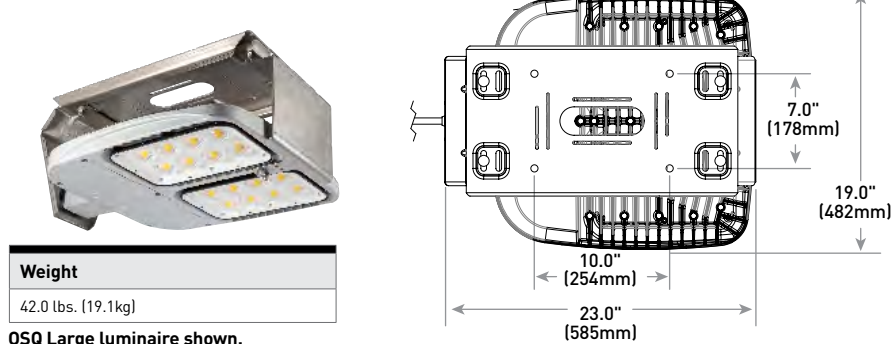

TM Mount

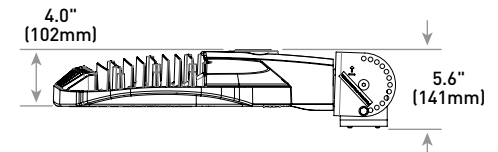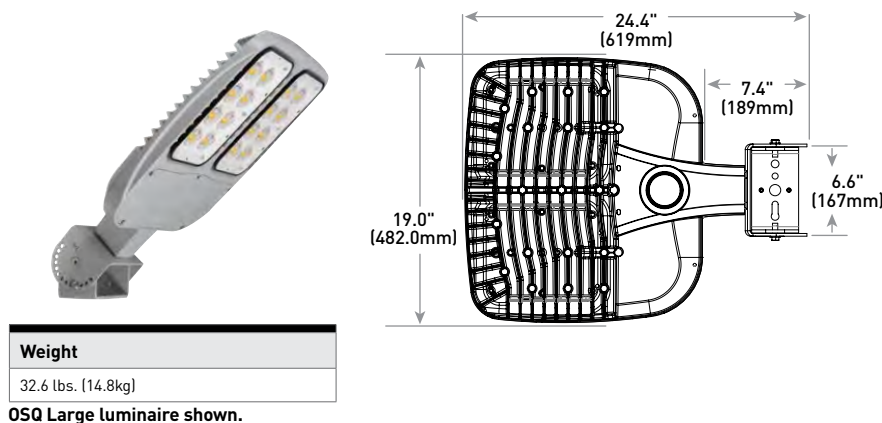

© 2020 Cree Lighting, A company of IDEAL INDUSTRIES. All rights reserved. For informational purposes only. Content is subject to change. Patent www.creelighting.com/patents. Cree®, the Cree logo, TrueWhite®, Cree TrueWhite®, and the Cree TrueWhite Technology logo are registered trademarks of Cree, Inc. NanoOptic® and Colorfast DeltaGuard® are registered trademarks, and Precision Delivery Grid™ and OSQ™ are trademarks of Cree Lighting, A company of IDEAL INDUSTRIES. The UL logo is a registered trademark of UL LLC. NEMA® is a registered trademark of the National Electrical Manufacturers Association. The DLC QPL logo and the DLC QPL Premium logo are registered trademarks of Efficiency Forward, Inc. Synapse® is a registered trademark of Synapse Wireless, Inc. Verizon® is a registered trademark of Verizon Trademark Services LLC.

US: creelighting.com (800) 236-6800

Canada: creelighting-canada.com (800) 473-1234

CREE LIGHTING

A COMPANY OF IDEAL INDUSTRIES, INC.